



**Universal dimming actuator REG-K/4x230/
 150 W**




Article no.
 649315

**Universal dimming actuator REG-K/2x230/
 300 W**




Article no.
 649330

**Universal dimming actuator REG-K/230/
 500 W**



Article no.
 649350

**Universal dimming actuator REG-K/230/
 1000 W**



Article no.
 649310

Table of Contents

1.	Function	1
2.	Operation	2
3.	Installation	3
4.	Technical data	3
6.	Application overview	4
6.0.1	Universal dimming 3242/1.0	5

1. Function

The Merten universal dimming actuator REG-K allows you to connect the following loads to each channel and then switch and dim them (depending on the type of universal dimming actuator you have, you will have one or more channels available):

- ohmic loads (e.g. 230 V incandescent lamps)
- inductive loads (e.g. inductive transformers with low-voltage halogen lamps)
- capacitive loads (e.g. electronic transformers with low-voltage halogen lamps)
- a combination of ohmic and inductive loads
- a combination of ohmic and capacitive loads

The universal dimming actuator automatically recognises the connected loads - see the section on load detection.

i **Caution**
 The combination of capacitive and inductive loads on one channel can damage the devices. Using transformers to which no load or insufficient loads are connected (even for a brief period of time) to the secondary circuit (see technical data) can damage the devices.

i In the case of a mixed load (combination of ohmic and inductive, or ohmic and capacitive loads) on one channel, the ohmic load may not exceed 30% of the total connected load of this channel. Otherwise, the wrong load is detected. Different loads may be connected to different channels.

i When using inductive transformers, the load connected to the secondary circuit must be at least half the size of the nominal load of the transformer. If the load is too small, the channel may shut down automatically.

i **Caution**
 Each dimming channel used requires a minimum load for operation (see technical data). If this is not reached, malfunctions may arise.

i **Note**
 Socket-outlets may not be dimmed. The risk of overloading and the risk of unsuitable appliances being connected is too high.

2. Operation

Operate the dimmer via one of the following:

- KNX
- Mechanical extension unit (conventional push-button, electronic extension units)
- Channel buttons on the dimming actuator

If bus voltage is available, operation via the extension units and channel keys depends on the parameters of the application (see the separate application description).


If there is no bus voltage, you can do the following with the extension units and channel keys:

- Switch on/off: press the button briefly
- Dim brighter/darker: press the button and hold it down
- Memory function (switch on at last brightness value) on/off: press the button briefly 10 times

Load detection

The first time a channel is switched after the mains voltage is switched on, after a load is connected or after a short-circuit or overload at the output has been rectified, a load detection is carried out automatically (to determine whether an inductive, capacitive or ohmic load is connected). When this happens, the channel switches on for approx. 10 seconds at the maximum brightness, then goes out briefly, and then dims up to the maximum brightness.

Operating and display elements (using the REG-K/4x230/150 W as an example)

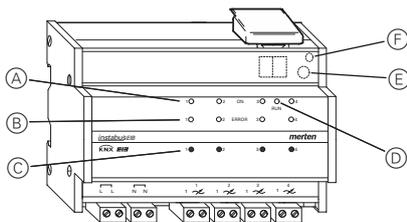

- A Channel status display (yellow)
- B Channel fault indication (red)
- C Channel button (manual mode)
- D Operating display (green)
- E Programming button (below cover)
- F Programming display (below cover)

Meaning of the displays


Operating display (green)	Channel status display (yellow)	Channel fault indication (red)	
on	off	off	Universal dimming actuator ready for operation (mains voltage and bus voltage available) and channel switched off
on	on	off	Universal dimming actuator ready for operation (mains voltage and bus voltage available), channel switched on (switching object = "1") or load detection
on	off	on	Overload or short circuit. The channel has been switched off. Mains and bus voltage available
on	on	on	No load at output (idle). The channel has been switched off. Mains and bus voltage available
off	off	off	No bus voltage and channel switched off, or no mains voltage
off	on	off	No bus voltage and channel switched on
off	off	on	Overload or short circuit and no bus voltage. The channel has been switched off.
off	on	on	No load at output (idle) and no bus voltage. The channel has been switched off.
flashes	on/off	all on	Excess temperature. All channels that are switched on are dimmed to minimum power/minimum brightness. Channels which are currently switched off cannot be switched on. See also the section "How to recognise faults".

3. Installation



Caution
 All appliances that are installed next to the dimming actuator must be equipped with at least basic insulation.

- Snap onto a 35 x 7.5 mm DIN profile rail which conforms to standard DIN EN 50022.
- Connect the bus plug and attach the cover of the bus connecting terminal.
- Connect the cables for the mains voltage, the outputs and the extension inputs.

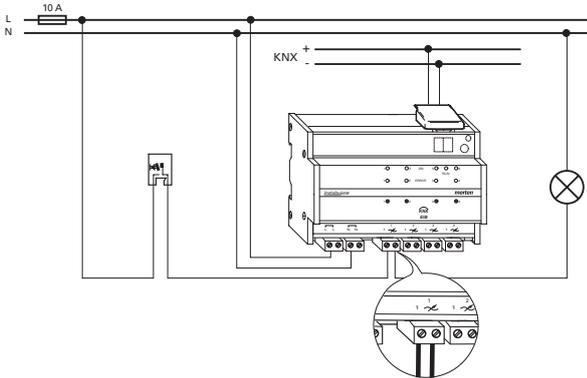

Risk of fatal injury from electric current.
 The outputs may carry an electrical voltage even when the dimmer is switched off. Always disconnect the fuse in the incoming circuit from the supply before working on connected loads (safety notes from DIN VDE 0105).



Caution
 The extension inputs must be connected to the same phase as the power supply of the dimming actuator.



Both connecting terminals for the L and the N connection are jumpered internally for all universal dimming actuator types. The connections of the dimming output and the extension input of a channel are either individual terminals or two internally jumpered terminals (pay attention to the marking), depending on the dimming actuator type.

4. Technical data

Power supply
 KNX: DC 24 V/approx. 5 mA
 Insulation voltage: AC 4 kV bus/mains voltage
 Nominal voltage: AC 220 - 230 V, 50/60 Hz (fuse 10 A)

Minimum nominal power:
 All dimming actuators:
 > 30 W ohmic loads
 > 50 VA inductive loads
 > 50 VA capacitive loads

Maximum nominal power (ohmic/inductive or ohmic capacitive):
 REG-K/230/1000: 1000 W/VA
 REG-K/230/500: 500 W/VA

REG-K/2x230/300:

Assignment	Ch** 1 W/VA	Ch 2 W/VA
2 channels	300	300
1 channel	500	-*
	-*	500

REG-K/4x230/150:


Assignment	Ch 1 W/VA	Ch 2 W/VA	Ch 3 W/VA	Ch 4 W/VA
4 channels	150	150	150	150
3 channels	300	-*	150	150
	150	150	-*	300
2 channels	300	-*	-*	300
1 channel	300	-*	-*	-*
	-*	300	-*	-*
	-*	-*	300	-*
	-*	-*	-*	300

* No loads may be connected.

** Ch = Channel



The maximum power values specified presume a mains frequency of 50 Hz and an ambient temperature up to approx. 30 °C. When operating with a mains frequency of 60 Hz, the maximum power values are reduced by approx. 15%. The changes in power relative to the ambient temperature can be seen in the diagram which follows.

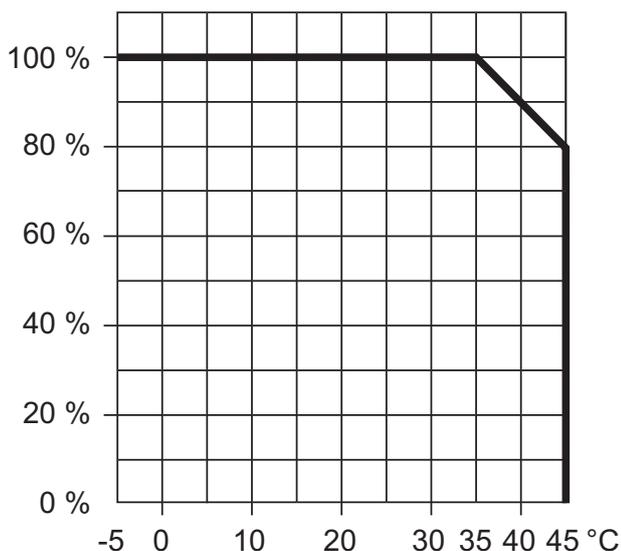

Ambient temperature:
 Operation: -5 °C to +45 °C
 Storage: -25 °C to +55 °C
 Transport: -25 °C to +70 °C
 Max. humidity: 93 % relative humidity, no moisture condensation
 Environment: the device is designed for use at an installation height of up to 2000 m above sea level (MSL)
 Type of protection: IP 20
 Connections:
 Inputs, outputs: Screw terminals
 single-core: 1.5 mm² bis 2.5 mm²
 finely stranded (with connector sleeve): 1.5 mm² bis 2.5 mm²
 KNX: bus connecting terminal
 Maximum cable length between extension input and extension unit:
 mechanical extension units: 100 m
 electrical extension units (e. g. 573999): 20 m (max. 10 with a max. total cable length of 20 m)
 Nominal voltage of extension units: AC 230 V ±10%, 50/60 Hz (identical phase to mains connection)
 Protection functions: Electronic load detection
 Short-circuit, overload and idling detection
 Excess temperature detection (dimming actuator temperature)
 Guidelines: 73/23/EEC low-voltage guideline
 85/336/EEC EMC guideline

5. Settings in the EIB Tool Software (ETS)

Selection in the product database

Manufacturer: Merten
 Product family: 4.6 Universal dimming actuator
 Product type: 4.6.01 DIN rail-mounted REG-K
 Program name: Universal dimming 3242/1.0
 Media type: Twisted Pair
 Product name: Universal dimming actuator REG-K
 Order number: 6493xx

i To guarantee the full functionality of the applications under ETS2, ETS2 version 1.2 or higher and Service Release A or higher should be used. If you have any queries, please contact the Merten infoline.

6. Application overview

Application	Vers.	Function
Universal dimming 3242/1.0	1	Dimming operation (KNX, extension units and on device)
		Different dimming curves and dimming speeds
		Same dimming time
		Memory function
		ON/OFF delay
		Staircase time function with/without manual OFF function
		Scenes (up to eight stored brightness values can be retrieved)
		Central function
		Logic operation or priority control
		Blocking function
		Status feedback
		Behaviour on bus voltage recovery

6.0.1 Universal dimming 3242/1.0

● **General information on the application**

You can use this software application to program universal dimming actuators from the REG-K range with a manual mode and extension input. The universal dimming actuators control the brightness of the connected luminaire. You can configure the control function separately for each output channel of the dimming actuator.

You can also operate the dimming actuator using the channel keys at the front of the device, or via extension unit push-buttons. For more information, please refer to the section "Manual operation and status displays". Group addresses are managed dynamically. The maximum total for the group addresses and associations is 172.

The limit for the telegram rate of the device is set to 127 telegrams every 17 seconds.

Caution: If you switch back to the preset values in the ETS, then all of the changes that you have made up to then will be reset.

i Note: Due to the fact that some functions depend on other functions, the corresponding tabs and parameters for these functions are only visible and can be selected in the ETS when the respective functions are activated or have been enabled.
 If you disable functions or change parameters, group addresses that have already been connected may be deleted again.

i Note: The values of some parameters only become active when those functions which are influenced by these parameters are activated.

i Adjustable times (staircase timer, ON delay, OFF delay etc.) are adjusted via the time base and time factor parameters. The actual time is calculated by multiplying both values; e.g. time base 1 second times time factor 3 gives 3 seconds.
 When only one of these parameters is displayed, the time for the selected parameter setting cannot be set. However, if appropriate, other factors in other tabs may influence the times.

● **Application functions**

With this software application, the universal dimming actuator is capable of executing the following functions:

- **Basic functions**

Switching (1 bit), relative dimming (4 bit), absolute dimming/value dimming (1 byte)

- **Advanced functions**

Time functions (ON/OFF delay, staircase timer), scenes, central function

- **Higher-level functions**

Logic operation or priority control, disable function
 The individual functions and the possible parameter settings in ETS are described in the sections below.


● **Setting the dimming parameters**

Dimming range


The range between the minimum and maximum brightness of a lamp which can be set with the aid of a dimmer is specified by the technical dimming range.

The minimum brightness value which can be set corresponds to the dimming value of 1%.

The maximum brightness value which can be set corresponds to the dimming value of 100%.

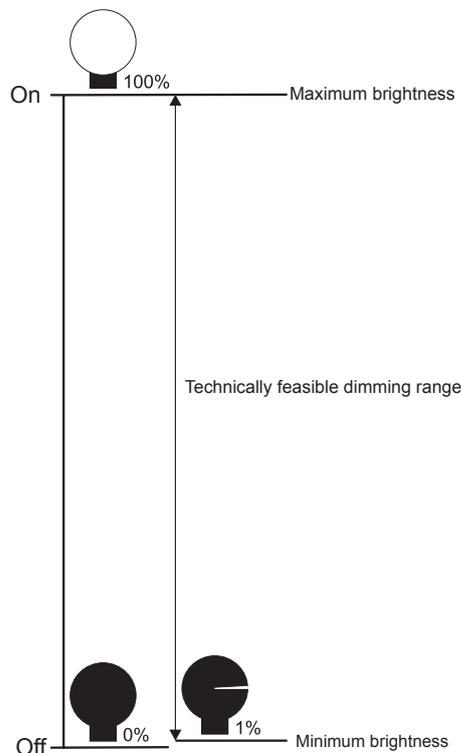

The dimming range which is technically possible can be limited using the software application to a minimum and a maximum dimming value. This limitation can be set individually for each output channel.

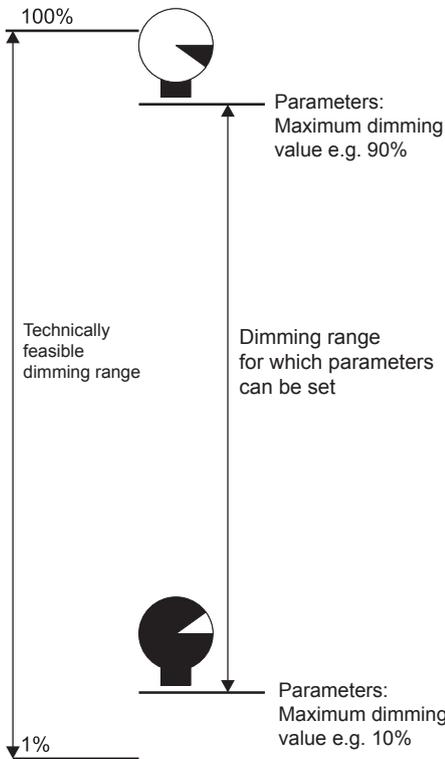

The dimming range which can be parameterised is set using the following parameters:

Tab	Parameter
X: General	Minimum dimming value in %
	Maximum dimming value in %

The limits of the parameterised dimming range may not be exceeded or not reached. If, regardless of the function, a telegram is received which demands a lower or a higher value, the respective minimum or maximum value is set (for information on the possible functions, please refer to the section later on in this manual).

Example: minimum dimming value = 10%, maximum dimming value = 90%
 Telegram value = 5% => output = 10%
 Telegram value = 70% => output = 70%
 Telegram value = 95% => output = 90%

● **Basic dimming curve**

You can use the basic dimming curve to adjust the control behaviour of a channel to the physical characteristics of different luminaires.

Specific basic dimming curves are stored in the software application for incandescent lamps and halogen lamps. You can select the basic dimming curve for each channel via a parameter:


Tab	Parameter
X: General	Basic dimming curve

If you wish to set your own dimming curve, select "adjustable". You can then change the setting of the threshold values and the times of the dimming sections in the "Basic dimming curve" tab:

Tab	Parameter
X: Basic dimming curve	1. threshold value in %
	2. threshold value in %
	3. threshold value in %
	Time base for 1st dimming section
	Time factor for 1st dimming section (1-255)
	Time base for 2nd dimming section
	Time factor for 2nd dimming section (2-255)
	Time base for 3rd dimming section
	Time factor for 3rd dimming section (3-255)
	Time base for 4th dimming section
Time factor for 4th dimming section (4-255)	

The basic dimming curve is divided into four dimming sections. You can determine the initial value of the dimming curve via the parameter value "Minimum dimming value in %", and the final value via the "Maximum dimming value in %" parameter value. The interim stages are determined by three threshold values.

With the time base and time factor, you define the length of time until the next threshold value is reached. This time change to the dimming value gives the dimming speed.

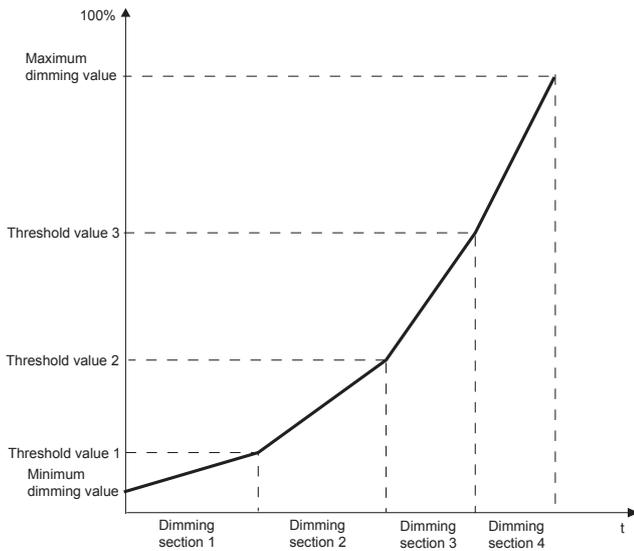

i The dimming hardware requires at least 500 ms to run through the entire dimming range from 0% to 100%. Please observe this limit value when setting the dimming times for the individual dimming sections. Overall dimming times which are shorter than 500 ms cannot be executed by the hardware.

i Note: The dimming curve (the actual voltage curve applied to the output over the time period) is still influenced by the dimming time reductions of the dimming reduction sets, and by the dimming time reduction object; please refer to the section on dimming speed.

When setting your own dimming curves, please observe the following limitations:

- The period for running through an entire dimming curve is limited to 24 hours. Should longer running times result from the settings you have made, the software application will determine a corrective factor itself, which will reduce your settings back down to 24 hours.
- The following conditions apply for the set threshold values: The 1st threshold value must be larger than or equal to the set minimum dimming value. Otherwise, the 1st threshold value will be set equal to the minimum value. The 2nd threshold value must be larger than or equal to the 1st threshold value; otherwise, it will be set as equal to it. The 3rd threshold value must be larger than or equal to the 2nd threshold value; otherwise, it will be set as equal to it. If the 3rd threshold value is larger than the maximum dimming value, this maximum value determines the upper brightness limit.

TIP: Brightness levels which are approximately the same are located between dimming values with the sequence 10, 20, 50, 100 (%).

● **Dimming speed**

In the basic dimming curve, you define a basic dimming speed.

This basic dimming speed is then further increased by the reductions in dimming time.

The actual dimming speed therefore results from the time factors for the basic dimming curve and the parameters for the reductions in dimming time. Here, you can set a dimming time reduction once, regardless of the function or telegram type, and you can also activate another dimming time reduction object via which the dimming time can again be reduced.

The reductions in dimming time always uniformly influence all dimming sections in the basic dimming curve.

You can use these parameters or this object to then reduce the dimming speed of the basic dimming curve. When the value for these parameters or for this object is 100% or 225, the dimming speed corresponds to the total of the times of the basic dimming curve. When the value is 50%, the dimming time of the basic dimming curve is halved, for example.

i Since the dimming time can only be reduced with these reductions in dimming time or the dimming time reduction object, it makes sense to parameterise the basic dimming curve to the maximum times required. The speeds can then be adapted to the respective functions using the dimming time reductions in the dimming time reduction sets.

i If the dimming time reduction object is deactivated, or dimming time reduction sets 1 to 3 are blocked, the basic dimming curve is subjected to the dimming time reductions in set 0.

The pre-set values in this set thus always give different dimming speeds for the different functions or incoming telegram types. Only when all dimming time reductions in set 0 are parameterised to 100% or 225 will the dimming speed for all incoming telegrams correspond to the basic dimming curve.

You can define a total of four dimming time reduction sets, which you can then activate using the set object. You can use the dimming time reduction parameter format to select the input format for this parameter: input as a percentile via a selection list (1% to 100% in defined steps), or numerical input (1 to 225). With the numerical input, the value 225 corresponds to 100%.

Tab	Parameter
X: Dimming time reductions	Format for dimming time reductions for sets

Adapting the dimming speed in relation to the dimming function

The channel output is triggered differently depending on the incoming telegram type (according to the assigned communication object) and the set parameters.

The universal dimming actuator (or the application) provides different functions to control the outputs. The way in which this dimming function operates will be described in the following chapters.

The dimming speed can be changed according to the dimming function. You can change the dimming speed by reducing the dimming time. The different dimming time reductions for the different dimming functions are compiled as sets. You can define four sets.

You can select which set is to be used via the set object. After initialising, set "0" is always active. The other sets must be enabled beforehand.

Tab	Parameter
X: Dimming time reductions	Set 1 to 3

If the set object receives a value between "0" and "3", the respective set is activated. Values outside of this range (invalid values) will cause set "0" to be activated.

Each set has six dimming time reductions available, which can influence the dimming curve depending on the dimming function or type of telegram:

- for switching telegrams (switch object and central switch object), switch on the staircase lighting
- for dimming telegrams (dimming object and central dimming object)
- for switching off the staircase lighting
- for value telegrams (value object and central value object)
- for scene telegrams
- for high priority functions (logic operation, priority control or disable function)

Tab	Parameter
X: Dimming time reductions	Set 0 to 3: Dimming time reduction for switching telegrams and switching on staircase lighting at
	Set 0 to 3: Dimming time reduction for dimming telegrams at
	Set 0 to 3: Dimming time reduction for switching off staircase lighting at
	Set 0 to 3: Dimming time reduction for value telegrams at
	Set 0 to 3: Dimming time reduction for scene telegrams at
	Set 0 to 3: Dimming time reduction for high priority functions at

You can use these parameters to modify the dimming speed (based on the basic dimming curve) for a large number of solutions. Some examples:

- faster dimming brighter and darker when switching ON and OFF: dimming time reduction for switching telegrams and switching on staircase lighting at 50%.
- faster dimming up and slower dimming down of the staircase lighting: dimming time reduction for switching telegrams and switching on staircase lighting at 30%, and dimming time reduction for switching off staircase lighting at 70%.
- slower dimming up and down for value dimming: dimming time reduction for value telegrams at 80%.
- faster setting of the scene values: dimming time reduction for scene telegrams at 40.

i With a set value of 100% or 225, the actual dimming curve precisely corresponds to the basic dimming curve.

i The values for "Switching off staircase lighting" only have an influence when no cut-out warning has been parameterised; see the section "Staircase lighting function".

Adapting the dimming speed using the "Dimming time reduction object"

When the dimming time reduction object is activated, the communication object "Dimming time reduction object" appears.

Tab	Parameter
X: Dimming time reductions	Dimming time reduction object

If the "Dimming time reduction object" receives a valid object value (between 1 and 255, the dimming time results from: (parameterised dimming time to date) x (value of "Dimming time reduction object") / 255.

e.g.
 Dimming time parameterised to date = 20 s
 Value of "Dimming time reduction object" = 25
 => Dimming time = 20 x 100 / 255 = 7.8 s

Functional change while a dimming function is being executed

If the application receives a telegram for another dimming function while a dimming function is running, the parameters for the new dimming function are used immediately. The following illustration shows an example of this principle.

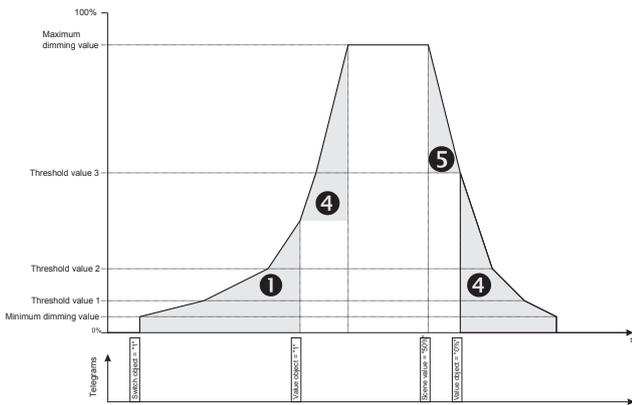


Image legend:

- ①: Dimming time reduction for switching telegrams and switching on staircase lighting.
- ④: Dimming time reduction for value telegrams.
- ⑤: Dimming time reduction for scene telegrams.

Communication objects


You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Channel X Dimming time reduction object for dimming curve	Dimming time reduction object	1 byte	Low	WC	Transmit/receive
Channel X set 1-3	Set object	1 byte	Low	WC	Transmit/receive

● **"Same dimming time" function**


As we have seen earlier in this section, different luminaires can have different dimming curves. The dimming speed is thus also different for these lamps, i.e. the time for running through the dimming range until the required dimming value is reached. Often, different luminaires are combined together in a scene or a central function. If a function of this type is now activated, the entire group of lamps begins to "dim up" to the required value. Depending on the type of luminaire and the scene value, some luminaires will reach the retrieved value earlier, others later. This effect will also be created when the luminaires addressed when a scene is activated have different brightness values.

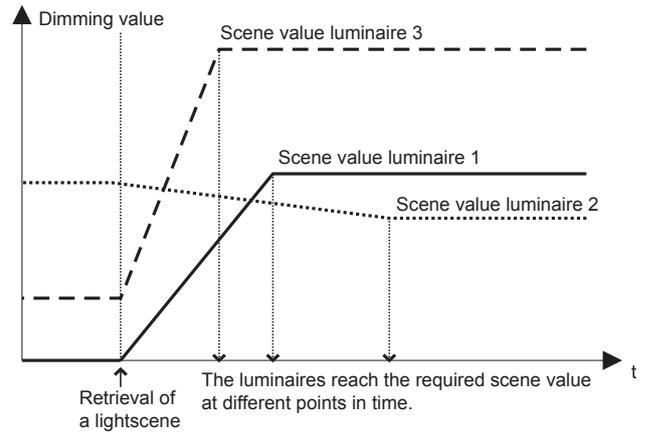

The "Same dimming time" function can be used to synchronise the different dimming times of the channels in such a way that all channels reach their set value at the same time. Using the "Time factor modifiable via the bus" parameter (via the communication object "Factor same dimming time"), the dimming times can also be synchronised for several dimming actuators.

i The "Same dimming time" function is only used in connection with scenes and the central function. If no scene or central function has been activated, the parameters for the same dimming time have no effect.

For the basic dimming curve, an offset factor is calculated when a scene or central function is retrieved, depending on the current output value and on the required function value. The basic dimming curve is extended or compressed, so that all the assigned luminaires reach the required function value at the same time.

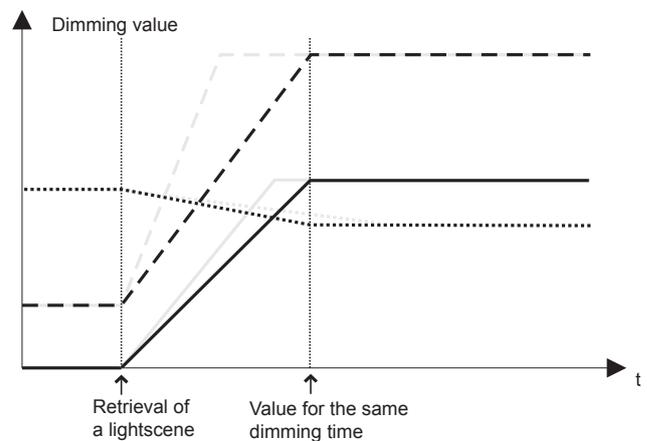

You can release the function globally for the device via a parameter, and set the corresponding dimming time after release:

Tab	Parameter
General	Same dimming time with central function and scenes

If the "Same dimming time" parameter has been activated, you can set the required dimming time in the "Same dimming time" tab and specify whether the time factor should be modifiable via the bus:

Tab	Parameter
Same dimming time	Time base for same dimming time
	Time factor for same dimming time 1-255
	Time factor modifiable via the bus

If you have activated the parameter "Time factor modifiable via the bus", a new communication object will now appear with the designation "Factor same dimming time". This object is now used to set the required time. In this case, the "Factor for same dimming time" parameter is only used for setting the time after a bus reset or download. As soon as the "Factor same dimming time" object has been described with a value for the first time, this value is used to set the time.


The assignment of the individual channels to the "Same dimming time" function is conducted individually for each channel for the scene function and central function.

i The dimming time reduction object and dimming time reduction sets are not taken into account for scenes and the central function for the duration of the same dimming time!

If ON or OFF delays have been parameterised, these delay times are taken into account when the offset factor is calculated, but are not modified. These delay times retain their set value. Only the gradient of the dimming curve, and thus the dimming speed, is modified.

Example:

Current output status: switched off,
 ON delay = 1s,
 same dimming time = 5s,
 retrieval of central function with output value 100%
 With the basic dimming curve, the output channel requires 8s in order to dim from the OFF status to 100%. Including the ON delay of 1s, this gives 9s.

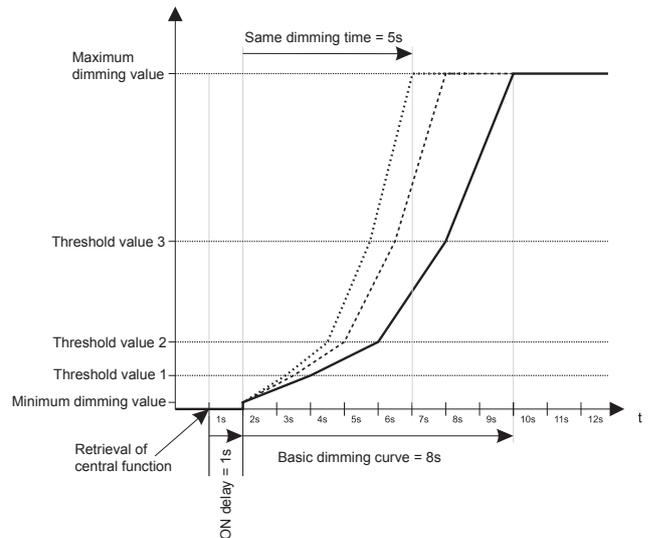

The ON delay is also retained with an identical dimming time. The dimming curve is compressed or extended in such a way that the dimming value is reached after the same dimming time. In other words, the calculation of the new dimming curve takes into account the pure dimming time (the same dimming time minus ON delay time).

i The set dimming time must be larger than 1 second and may not be smaller than any set ON and OFF delays with the individual output channels. If this is not the case, the same dimming time is ignored and the dimming curves are executed normally with the time factors and dimming time reduction sets.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Same dimming time	Factor same dimming time	1 byte	Low	WC	Transmit/receive

● **Priorities**

The functions of the application comprise different priorities in relation to their processing:

high priority	
3	Disable function
2	Logic operation or priority control
1	Switching, dimming, value dimming, time functions, scene, central function
low priority	

Priority group 1:

In priority group 1, all functions have an equal status, i.e. they can be overwritten by other functions. A function which is currently active is ended when a new control telegram with the same priority is received. New set values for the scene function, the time functions or the central function act in the same way as an update for the "Switch object" of an output channel in relation to the specification of the priority.

Priority group 2:

When a function from priority group 2 is activated, the dimmer output is triggered according to the now active output value. The function values for priority group 1 are overwritten and are no longer forwarded to the output, as long as the priority function is active. However, all control functions in priority group 1 continue to be calculated and updated in the background.

You can determine the reaction of an output after deactivation of priority control via a parameter (see the chapter in the manual on the priority control function); after a logic operation function has been deactivated, the output is always set to the current output value which the device has calculated in the background.

Priority group 3:

The disable function with the highest priority level 3 overrides all other functions. The functions in priority levels 1 and 2 also continue to be evaluated in the background here, however, so that after the disable function has been deactivated, the dimmer output can be set to the current required value, or can adopt a status for which the parameters have been set. You can also determine this output behaviour via a parameter in the same way as for priority control (for more on this topic, see the chapter in the manual on the disable function).



Please note that any function changes can also lead to changes in the dimming curve and thus the dimming speed (for more on this topic, see also the section on "dimming speed" earlier in this manual).

● **Basic functions**

The software application provides three basic functions to control the brightness of the connected luminaires: switching, relative dimming and value dimming.

For each output channel which you have activated via parameters, three communication objects appear to control these basic functions:

Tab	Parameter
X: General	Channel X

If you have set the parameter "Channel X" to the value "activated", the following objects appear:

- for the "Switch" function: "Switch object", length: 1 bit
- for the "Relative dimming" function: "Dimming object", length: 4 bit
- for the "Value dimming" function: "Value object", length: 1 byte

You will also find additional setting parameters on the parameter window for determining the functioning of the dimming output.

Switch function (1 bit)

If the "Switch object" receives a telegram with the value "1", the output is "switched on" and the activated dimming time reduction sets and, where appropriate, the dimming time reduction object, are triggered according to the basic dimming curve and the dimming time reduction "for switching telegrams and switching on staircase lighting". The output is "switched off" with the object value "0". In this case, the dimming curve is run through in reverse (from the maximum value to the minimum value); in other words, it is dimmed down.

You can use parameters to specify the maximum value which is triggered:

Tab	Parameter
X: General	Starting behaviour

Settings:

- max. brightness: The output channel is set to the value which you have set in the parameter "Maximum dimming value in %".
- selectable brightness: With this value, an additional setting parameter appears:

Tab	Parameter
X: General	Initial brightness in %

The output is switched on at the set initial brightness value with a "1" telegram. The initial brightness value should not exceed the maximum dimming value, since this always limits the maximum output brightness, and is also set when you select a higher value for the parameter.

-last brightness value (memory): The output is reset to the last brightness value which it had before switching off after a "1" telegram. After a download or bus voltage

failure, the value is set here which is defined as the maximum dimming value.

Relative dimming function (4 bit)

You can use the "Relative dimming" function to dim the output brighter or darker relative to its current value. The step size of the brightness change and the dimming direction are determined by the telegram value.

Telegrams for the "Relative dimming" function are received via the "Dimming object"

After a relative dimming telegram has been received, a new set value is calculated from the current value, the dimming direction received and the step size received.

Example (minimum dimming value = 10%, maximum dimming value = 90%, current output value = 12%):

Dimming brighter telegram with a step size of 25%
 => New set value: 12% + 25% = 37%

Dimming darker telegram with a step size of 12.5%
 => New set value: 37% - 12,5% = 24,5%

The "Minimum dimming value" and "Maximum dimming value" limit values must be reached, or cannot be exceeded with relative dimming.

You can use a parameter to determine the other functions of an output channel when a relative dimming telegram is received:

Tab	Parameter
X: General	Dimming object switches channel

Settings:

-not: This parameter setting prevents switching on and off, i.e. the channel remains off, or at the minimum dimming value.

-only on, not off: The output channel can only be switched on by relative dimming telegrams. If it is switched on and the set value fails to reach the minimum dimming value via relative dimming telegrams, the output remains switched on at the minimum dimming value.

-only off, not on: The output channel cannot be switched on by relative dimming telegrams. If it is switched on and the set value fails to reach the minimum dimming value via relative dimming telegrams, the output remains switched off.

-on and off: The output channel can only be switched on by relative dimming telegrams. If it is switched on and the set value fails to reach the minimum dimming value via relative dimming telegrams, the output remains switched off.

Value dimming function (1 byte)

The "Value dimming" function is used when you wish to set the required brightness directly. To do this, send the required brightness value to the "Value object" of the output channel as a percentage between 0% and 100%. The value range is divided into 255 brightness levels. One level has a step width of approximately 0.4%. The telegrams for dimming with absolute values have the 1 byte data format.

The required brightness values must lie within the limits which are specified by the minimum and maximum dimming value. If the brightness value exceeds the maximum dimming value, the maximum dimming value is set as the output value. If the brightness value is lower than the minimum dimming value, this is set as the output value.

You can complete the settings for switching the dimming output on and off via the "Value dimming" function using a parameter:

Tab	Parameter
X: General	Value object switches channel

Settings:

-not: This parameter setting prevents switching, i.e. the channel remains at the current value.

-only on, not off: The output channel can only be switched on by value telegrams. If it is switched on and the "Value object" receives the value 0%, the output remains switched on at the minimum dimming value.

-only off, not on: The output channel cannot be switched on by value telegrams. If it is switched on and the "Value object" receives the value 0%, the output remains switched off.

-on and off: The output channel can only be switched on by value telegrams. If it is switched on and the "Value object" receives the value 0%, the output remains switched off.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Channel X General	Switch object	1 bit	Low	WC	Transmit/ receive
Channel X General	Dimming object	4 bit	Low	WC	Transmit/ receive
Channel X General	Value object	1 byte	Low	WC	Transmit/ receive

● **Advanced functions**

The advanced functions are the functions of the software application which share the same priority as the basic functions "switch", "relative dimming" and "value dimming" (for more on this topic, see the section on priorities). The advanced functions are time

functions (ON/OFF delay, staircase timer), scenes and a central function. Any update of one of the basic functions or an advanced function overrides the current status, and sets the dimming output according to the last function value received.

Time functions

Delay functions

The delay functions delay the switching on or off of an output channel. They are switched upstream or downstream in relation to the actual output functions, i.e. they delay the execution of the requested output command.

The delay functions affect the basic functions and the advanced functions. The priority functions are always effective immediately and without a delay.

The dimming curve with the delay functions follows the basic dimming curve and the current dimming curve reduction of the current dimming curve reduction set and, when appropriate, the dimming curve reduction object (please refer to the earlier section on "Dimming speed").

You can select the delay functions for each channel via a parameter:

Tab	Parameter
X: General	Delay times

When you have enabled the delay functions for an output channel, a new parameter window will appear for this channel for activation and in order to make detailed settings for the functions.

– ON delay

The ON delay becomes active when the output is currently switched off, and is now set to be switched on via a new telegram for a basic function or an advanced function.


If you wish to use the ON delay, you must activate the function:

Tab	Parameter
X: Delay times	ON delay


Settings:

-deactivated: The ON delay is not active.


-retriggerable: If the channel receives an ON telegram, the ON delay is started. If a new ON telegram now follows while the delay time is running, the delay time is restarted. The value of the new telegram is set as the new set value, which is activated after the delay period has expired. If the new value is the "STOP dimming" value for relative dimming, the output value is set to the minimum dimming value after the delay period has expired.

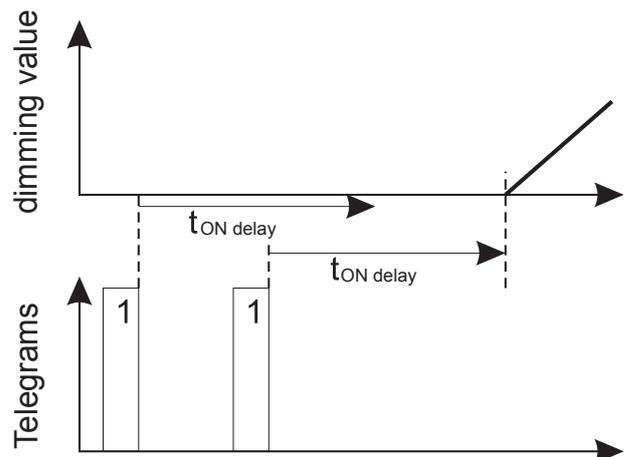

-not retriggerable: If the channel receives an ON telegram, the ON delay is started. If a new ON telegram now follows while the delay time is running, this is ignored and the ON procedure is executed after the delay time initially started has expired. The value of the new telegram is set as the new set value, however, which is activated after the delay period has expired. If the new value is the "STOP dimming" value for relative dimming, the output value is set to the minimum dimming value after the delay period has expired.

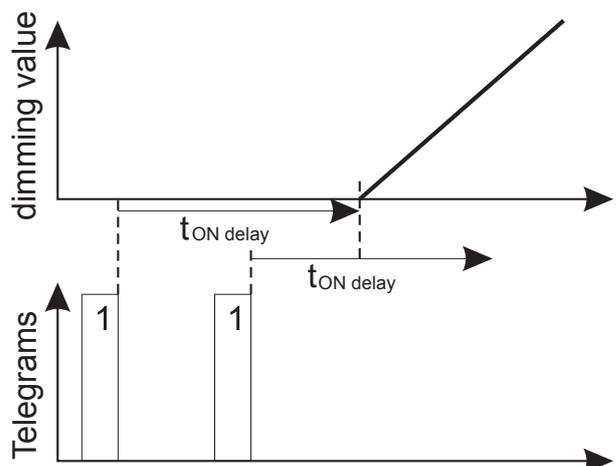

If the channel receives an OFF telegram while an ON delay is active, the ON delay is interrupted.

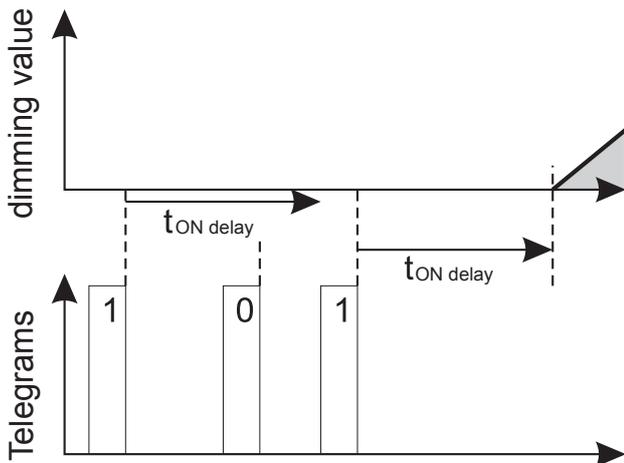

You can use a parameter to set whether the output channel remains switched off during the ON delay, or whether it is already set to the minimum dimming value.

Tab	Parameter
X: Delay times	Output during the ON delay

The specific delay time for the ON delay results as a product from the time base and the factor; the standard values result in an ON delay of 3 seconds.

Tab	Parameter
X: Delay times	Time base for ON delay
	Time factor for ON delay (1-255)

-- OFF delay

The OFF delay becomes active when the output is currently switched on, and is now set to be switched on via a new telegram for a basic function or an advanced function.

Please note: the OFF delay is not effective in a negative dimming direction with relative dimming commands, since these are not specific OFF commands.


If you wish to use the OFF delay, you must activate the function:

Tab	Parameter
X: Delay times	OFF delay


Settings:

-deactivated: The OFF delay is not active.

-retriggerable: If the channel receives an OFF telegram, the OFF delay is started. If a new OFF telegram now follows while the delay time is running, the delay time is restarted.

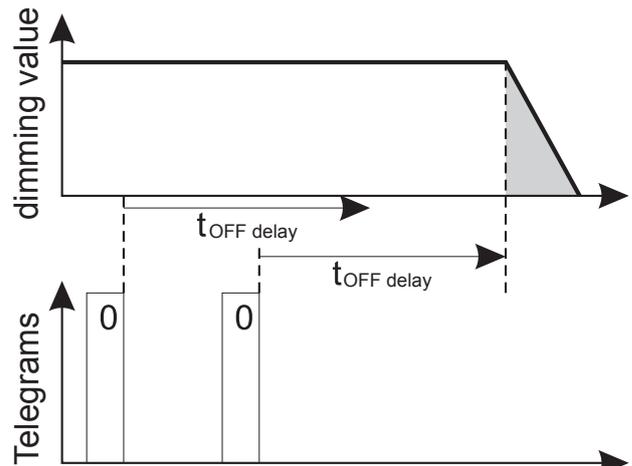

-not retriggerable: If the channel receives an OFF telegram, the OFF delay is started. If a new OFF telegram now follows while the delay time is running, this is ignored and the OFF procedure is executed after the delay time initially started has expired.

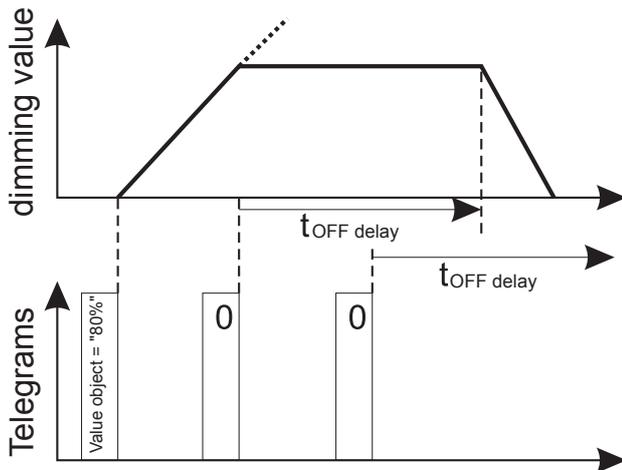

If the output receives a new telegram while an OFF delay is active, which creates an ON status, the OFF procedure is halted and the new set value is set.

If the output is currently conducting a dimming procedure when an OFF telegram is received, this dimming procedure is stopped. The output remains in the current dimming value for the duration of the OFF delay, before it switches off after the delay has expired (see the chart for the "not retriggerable" setting).

If a staircase lighting function with manual OFF is active, the output is not switched off immediately by a manual OFF command, but only when the set delay time has expired (please also refer to the following section on the staircase lighting function).

The specific delay period for the OFF delay results from your settings as a product of the time base and the factor:

Tab	Parameter
X: Delay times	Time base for OFF delay
	Time factor for OFF delay (1-255)

With the standard values, an OFF delay of 3 seconds is produced.


Staircase lighting function

The staircase lighting function offers you the option of switching on a dimmer output with a telegram in such a way that this output switches itself back off automatically after a specified time has expired, and without a new control telegram. Since this function is often used to control the lighting in staircases, it is named accordingly.

The dimming curve with the staircase lighting function follows the current dimming curve reduction of the current dimming curve reduction set and, when appropriate, the dimming curve reduction object (for more information on the dimming time reduction set, please refer to the earlier section on "Dimming speed").

i Please note that different dimming speeds may be present for the ON and OFF procedure.

i The staircase lighting time only begins when the output channel has reached the final dimming value after dimming up. The dimming time is therefore not included in the staircase lighting time. The dimming value during the staircase lighting time is the (parameterised) maximum dimming value.

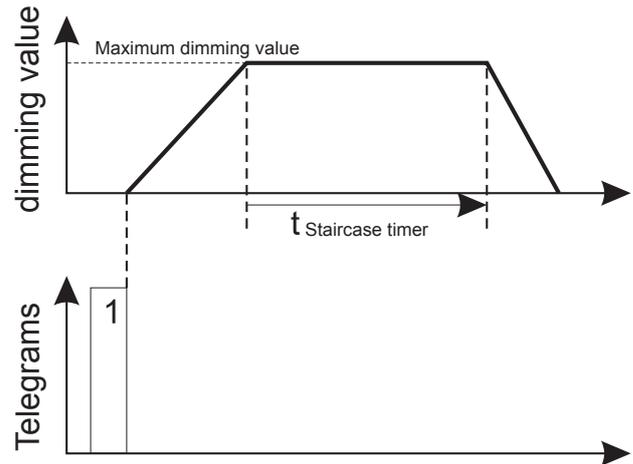

You can activate the staircase lighting function for each channel via a parameter:

Tab	Parameter
X: General	Staircase lighting function

When you have activated the staircase lighting function for an output channel, a new parameter window will appear for this channel, together with a new communication object labelled "Staircase lighting object". The "Staircase lighting object" has a 1 bit format. The staircase lighting function is controlled via the received telegram values of the "Staircase lighting object".

i Note: The staircase lighting function can alternatively be switched on via an extension unit push-button if you have specified this function for extension unit operation. It is not possible to switch off the staircase lighting function with extension unit operation.

The basis for this setting is given in the description of the staircase lighting function below. For more information on the extension unit function, refer to the section "Manual key operation".

You can set the time duration for the staircase lighting time via the time base and time factor:

Tab	Parameter
X: Staircase timer	Time base for staircase timer
	Time factor for staircase timer (1-255)

The time duration results from the product of your settings for the time base and factor. The standard values therefore result in a staircase lighting time of 3 minutes.

If the "Staircase lighting" object receives a telegram with the value "1", or if the staircase timer function is activated by an extension unit push-button which has been parameterised accordingly, the dimmer output is switched on and is dimmed to the max. dimming value, remains at this value for the set "Staircase lighting time", and the output channel then dims automatically to the value 0%.



Note: During the staircase lighting time, you can modify the output brightness using dimming telegrams via the "Dimming" or "Value object" objects. If the output fails to reach its minimum dimming value due to these dimming telegrams, or if the value object is described with the value "00h", the parameter settings for the OFF behaviour of these functions apply.

You can use the "Staircase lighting function" parameter to determine whether an active staircase lighting function can be manually interrupted or not:

Tab	Parameter
X: Staircase timer	Staircase lighting function


The individual settings have the following meaning:

- with manual OFF,... / without manual OFF,... : you can initially specify whether an active staircase lighting function can be manually interrupted (= "with manual OFF") or not (= "without manual OFF").


If you have set the parameter to the value "with manual OFF", the output is switched off when the "Staircase lighting" object receives a telegram with the value "0".




Note: "Manual OFF" does not refer to switching off the extension units manually, or to the manual keys on the device. "Manual OFF" means switching off via an EIB telegram.

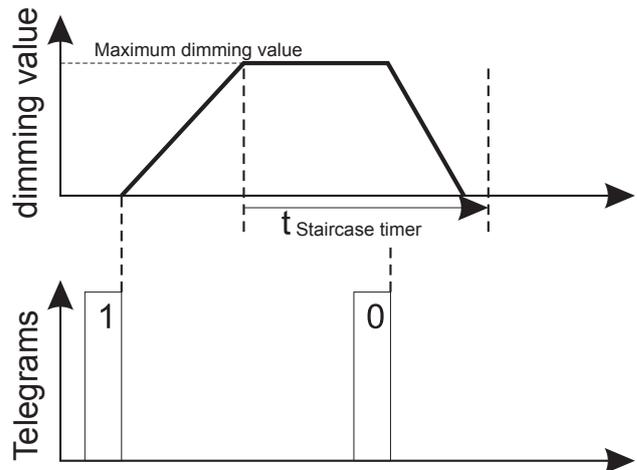


If an OFF delay has been parameterised, this function is now active and the output only switches off after the delay time has expired.

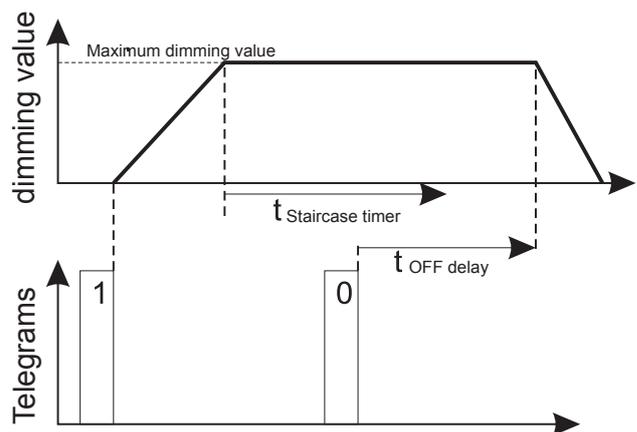


If you have selected the parameter value "without manual OFF", the staircase lighting function is not interrupted when a telegram with the value "0" is received, but continues to run normally until the staircase lighting time has expired.

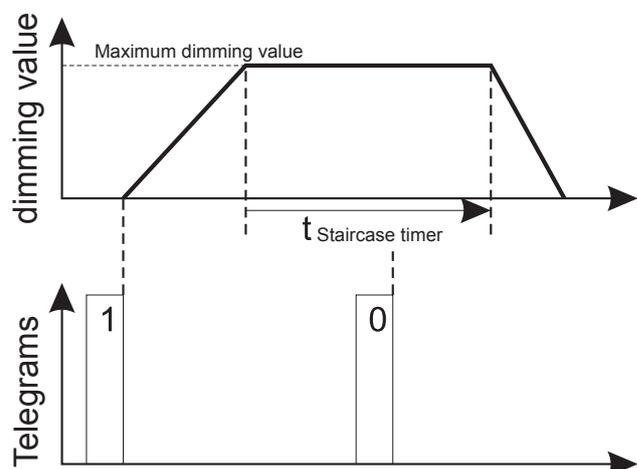


-..., not retriggerable: With this setting, the staircase lighting function which was started initially runs through normally, even when additional "1" telegrams or switch impulses from an extension unit push-button are received during the staircase lighting time.

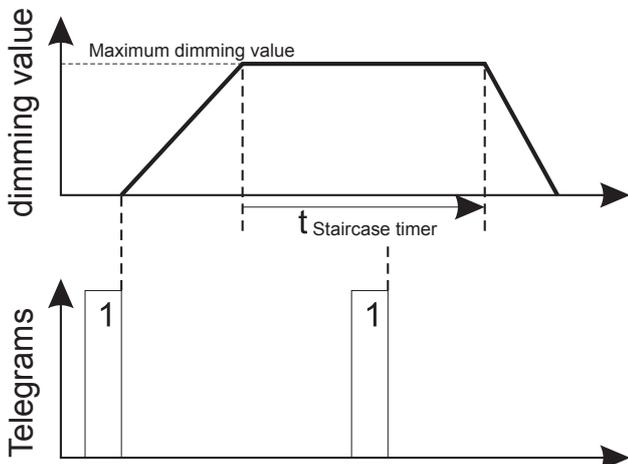

- ..., retriggerable: If the "Staircase lighting" object receives an additional "1" telegram while a staircase lighting function is active, or if switch impulses are received from an extension unit push-button, the staircase timer is restarted. This occurs when a "1" telegram or an extension unit impulse is received while the function is active.

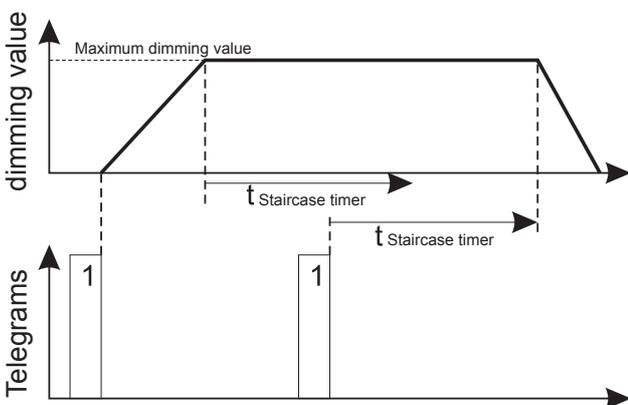

- ..., totalling time: If the "Staircase lighting" object receives a second start signal (a "1" telegram or switch impulse from an extension unit push-button), while a staircase lighting function is active, the active staircase lighting time is doubled. With a third start signal, the staircase lighting time is tripled, and with the fourth start signal, it is quadrupled. The actual staircase lighting time therefore results from the staircase lighting time being multiplied according to the number of received start signals. The maximum possible running time for this function is 255 hours.

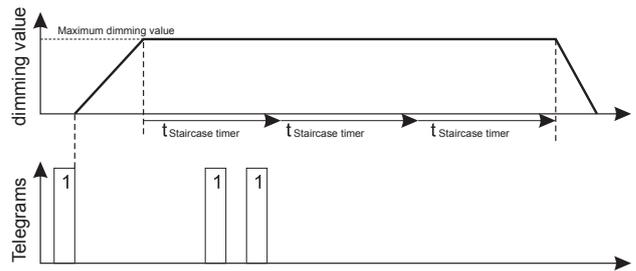


You can limit the potential running time using the "Max. number of time accumulations" parameter.

Tab	Parameter
X: Staircase timer	Max. number of time accumulations (2- 255)

If the staircase lighting time has expired, the dimming output is dimmed down and switched off according to the settings for the dimming speed and the current speed set. You can however use the function "Cut-out warning" to influence the dimming down behaviour over time at the end of a staircase lighting function:


Tab	Parameter
X: Staircase timer	Cut-out warning for staircase lighting time
	Warning time for staircase lighting time in seconds (1-255)

If you have activated the cut-out warning, you can set a "Warning time" as a time period between 1s and 255s (=4min15s). This "Warning time" determines how long the dimming down procedure should last. The active values for the dimming speed and the dimming time reduction sets are no longer taken into account in this case. The dimming curve is extended or compressed to the set warning time while dimming down.

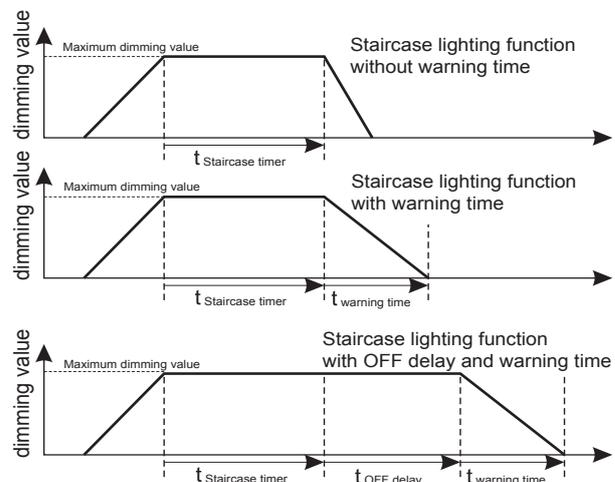

Regardless of which dimming value the output has after the staircase lighting function has expired, the time duration for the dimming down procedure always

corresponds to the warning time when the cut-out warning is active.

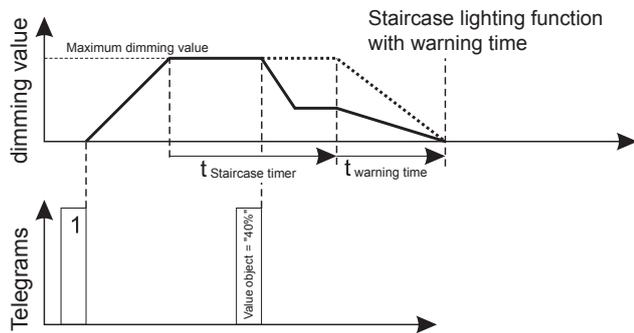


If you have parameterised a cut-out delay for the dimmer output, the warning time begins after the delay period has expired.

Note: After the staircase lighting time has expired, a new staircase lighting function sequence is started when a new "1" telegram is received at the "Staircase lighting" object, or when a new switch impulse is received from an extension unit push-button, even when the output is still dimming down, or when a warning time is active. At this point in time, a "1" telegram or a switch impulse is therefore no longer valid as a trigger signal for restarting the staircase lighting time, or to accumulate the staircase lighting times.

Logic operation between the switch object and the staircase lighting object

In order to control a dimming output, its switch object is connected with its staircase lighting object with a logical OR operation.

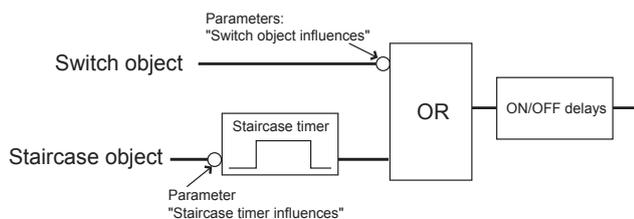


You can invert, or not invert, the effect of the two object values on this logic operation using parameters:

Tab	Parameter
X: General	Switch object influences
X: Staircase lighting time	Staircase object influences



If you set the parameter value to "not inverted", the logic operation is formed with the current object value; the object value "0" remains "0" and the object value "1" remains "1".

If you set the parameter value to "inverted", the logic operation is formed with a value which is opposite to the current object value; Object value "0" becomes "1" and object value "1" becomes "0".

You can overwrite a running staircase lighting function using a telegram for the switch object. In this case, the staircase lighting function continues to run normally in the background.

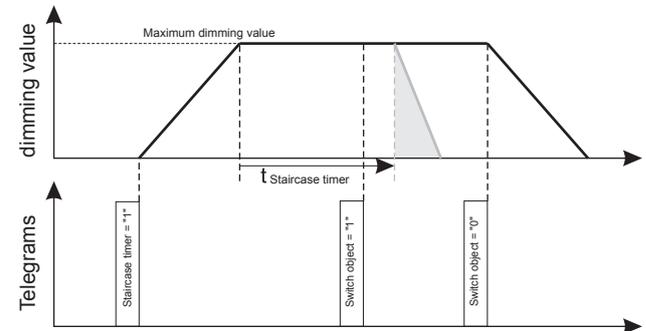

The brightness of the logic operation result and the dimming speed is defined by the last telegram (see the charts below).

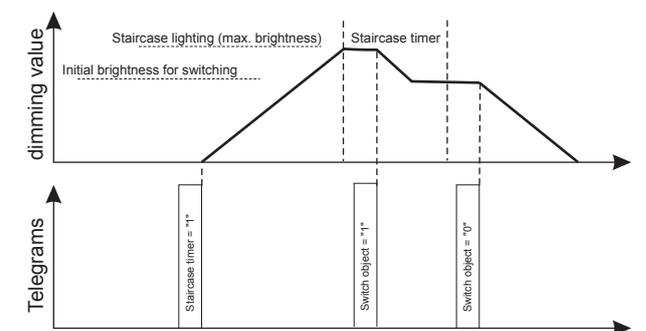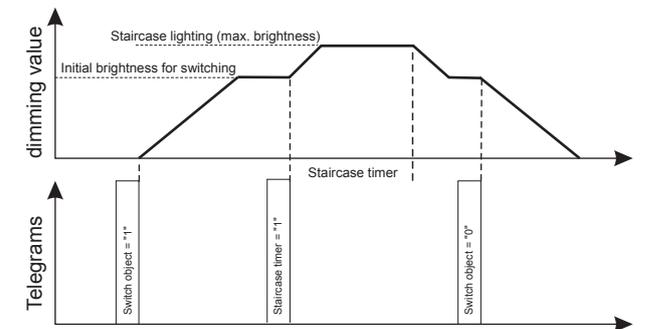

You can use this, for example, for temporary continuous light switching (cleaning lighting). An ON telegram from the switch object causes the light in the staircase lighting function to remain switched on continuously. Value, dimming, scene and central telegrams continue to be influential, however. For an application of this type, an initial brightness of 100% would be suitable when switching on.

Another potential application is a staircase lighting function with a continuous basic brightness (e.g. in hospital corridors). For this purpose, the required basic brightness is parameterised as the initial brightness when switching on, and the staircase lighting function is switched e.g. via a movement detector.



Please also refer to the section "Logic operation" in relation to this topic.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Channel X Staircase lighting object	Switch object	1 bit	Low	WC	Transmit/receive

● **Scenes**

You can use the scene functions when you wish to give the user the option of modifying different room functions simultaneously via just one bus telegram. Retrieving a room scene allows you, for example, to dim the room lighting to a desired value, move the blinds into a desired position, set the heating control to daytime operation and switch on the power supply to the socket-outlets in a room. Due to the fact that these functions can have different telegram formats and moreover, the telegram values can have different meanings (e.g. value "0" means OFF for lighting and OPEN for blinds), without the scene function you would have to send a separate telegram to each actuator to achieve the same setting.

The scene function allows you to integrate the dimming actuator into scene control. There are memory slots for up to 8 different scene values for each output channel. Each of these 8 scene memories can be assigned to one of 64 possible scene numbers (0 to 63). You can store the brightness value in % as scene values. If the dimming actuator receives a telegram which retrieves a scene number, the assigned output channel is dimmed to the stored brightness. The brightness values for the individual scenes which you save during commissioning can be replaced later by users if they wish.



If the learn bit in a telegram has the value "0", the brightness values saved for this scene number are retrieved and the dimmer outputs are set accordingly. If the learn bit has the value "1", then the current brightness values of the assigned dimming outputs are saved as new scene values for the transmitted scene number.

Activating the scene function:

In order to be able to use the scene function for the individual dimming channels, you first have to priority enable the function for the device once:

Tab	Parameter
General	Scenes

If you have set the "Scenes" parameter to the activated value, the communication object "Scene object"

appears, via which the scene telegrams can now be received.

Now you can activate the scene function for each channel individually:

Tab	Parameter
X: General	Scenes

If you have activated the "Scenes" parameter of an output channel, a new parameter window appears for this channel, in which you can set the scene values. You can activate each of the eight scene memories separately:

Tab	Parameter
X: Scenes	Scene 1 to scene 8

You can assign a scene number (0-63) to each of the activated scenes and set a brightness value:

Tab	Parameter
X: Scenes	Scene 1 to scene 8, Scene number (0-63)
	Scene 1 to scene 8, Brightness value in %

When setting the brightness values, please observe the limits set by the minimum and maximum dimming values.

Retrieving scene values:

The "Scene object" allows you to retrieve stored brightness values. After receiving a telegram, the transmitted scene number is evaluated. If one of the eight scene memories has been assigned to this scene number, the stored brightness value is set.



If several of the scene memories 1 to 8 have been assigned to the same scene number, the first memory value is activated.

Storing scene positions:

When the "Scene object" receives a new telegram in which the learn bit has the value "1", the current dimming value is stored as the new brightness value in the first scene memory which is assigned to the received scene number.

Example:

Output channel 1

Scene 1 activated at scene number 13
 (Scene 1 brightness = 50%)

Scene 2 activated at scene number 7
 (Scene 2 brightness = 30%)

Scenes 3 to 8 deactivated

Output channel 2

Scene 1 activated at scene number 7
 (Scene 1 brightness = 90%)

Scene 3 activated at scene number 21
 (Scene 3 brightness = 50%)

Scenes 2 and 4 to 8 deactivated

Retrieve scene number 13

=> Output channel 1 dims to 50%

=>Output channel 2 does not respond

Retrieve scene number 1

=> Actuator does not respond because scene number 1 is not assigned.

Retrieve scene number 7

=> Output channel 1 dims to 30%

=> Output channel 2 dims to 90%

Retrieve scene number 21

=>Output channel 1 does not respond

=> Output channel 2 dims to 50%

Outputs are manually dimmed to the new values:

Output channel 1: Brightness = 70%

Output channel 2: Brightness = 20%

Program scene number 13

=> Output channel 1: Scene 1 Brightness value = 70%

=> Output channel 2: does not respond, since scene number 13 has not been assigned.

Retrieve scene number 13

=> Output channel 1 dims to 70%

=>Output channel 2 does not respond

Note the difference from the first retrieval of scene number 13 above!

If you activate the parameter "Replace scene values in the actuator on download", then the scene values programmed during operation which are stored in the device for this channel are replaced with your default values on download. If you don't wish to replace the values in the device when downloading, then you must disable this parameter:

Tab	Parameter
X: Scenes	Replace scene values in the actuator on download

Same dimming time for scene function

The general information section in this manual on "Dimming speed" contains an explanation of the "Same dimming time" function. You can assign the scene functions of an output channel to this function via a parameter:

Tab	Parameter
X: Scenes	Same dimming time

Extension unit function for scenes

This function allows you to also activate or re-program the scene values for the scene memories 0 to 3 also using 1-bit telegrams. The extension unit function is activated once for the device:

Tab	Parameter
General	Extension unit scenes

If you have enabled "Extension unit scenes", the additional communication objects appear with the 1-bit data format:

"Retrieve scene 0/1", "Retrieve scene 2/3",

"Set scene 0/1", "Set scene 2/3".

You can also use these objects to retrieve scenes 0 to 3 or to re-program them:

"Retrieve scene 0/1"" = "0": Scene number 0 is activated

"Retrieve scene 0/1"" = "1": Scene number 1 is activated

"Retrieve scene 2/3"" = "0": Scene number 2 is activated

"Retrieve scene 2/3"" = "1": Scene number 3 is activated

"Set scene 0/1" = "0": Scene number 0 is programmed

"Set scene 0/1" = "1": Scene number 1 is programmed

"Set scene 2/3" = "0": Scene number 2 is programmed

"Set scene 2/3" = "1": Scene number 3 is programmed

The actions correspond to a normal retrieval or program command for scene numbers 0, 1, 2 or 3 using the "Scene object". The extension unit function is not available for scene numbers 4 to 63. You can only address these scene numbers using the "Scene object".

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Scenes	Scene object	1 byte	Low	WC	Transmit/ receive

● **Central function**

You can use the central function to switch or dim several output channels simultaneously with a telegram command. This function is useful, for example, when you switch off all the lights at the press of a button when leaving your house, and when you wish to switch on a certain group of lights at the press of a button when you return home. Another possible application for the central function could be to set the lights to a low dimming value on the way to the bathroom at the press of a button, in order not to wake the other people living in your house.

If you wish to use the central function for one or more output channels, you must priority enable the function for the device once:

Tab	Parameter
General	Central function

If you have activated the central function for the appliance, three new communication objects will be available, which you can in turn activate or deactivate individually using parameters:

Tab	Parameter
General	Central switch object
	Central dimming object
	Central value object

The activated objects appear as new communication objects "Central switch object", "Central dimming object" and "Central value object" after they have been activated.

Assigning the output channel to the central function:

You can select the assignment of an output channel to the central function individually for each channel when parameterising:

Tab	Parameter
X: General	Central function

When you have assigned a channel to the central function, the output value of this dimming output cannot be controlled only via the specific switching, dimming or value objects for the channel (see the "Basic functions" section), but also via the enabled objects in the central function. The central function controls the entire assigned group of channels simultaneously.

Switching via a central object:

After the central function for an output channel has been activated, a new parameter window appears for this channel. In this parameter window, you can set how the assigned channel should respond when a new telegram value is received via the "Central switch object":

Tab	Parameter
X: Central function	Function with the central switch object = 0
	Function with the central switch object = 1

First select how the output should react when a new object value is received for the central object. If you wish to set a variable brightness, you can specify the required values in further parameters:

Tab	Parameter
X: Central function	Required brightness with central switch object = 0 in %
	Required brightness with central switch object = 1 in %

Please ensure here that the set values lie within the limitation set by the minimum and maximum dimming values respectively.

Relative dimming and value dimming via the central function

The two dimming functions in the central function operate in the same manner as the corresponding basic functions (see also the section "Basic functions").

With these functions, the telegrams also affect the entire group of assigned output channels simultaneously. The "Central dimming object" causes relative dimming operations, while the "Central value object" sets a new absolute dimming value for the group.

Dimming speed of the central function

The dimming speed for operations via the central functions corresponds to the settings for the corresponding basic functions. The dimming time for setting a new brightness value therefore corresponds to the setting for the active dimming reduction set for the switch function, the setting for the active dimming time reduction set for relative dimming and the setting for the active dimming time reduction set for value dimming.

Same dimming time for central function

The software application also offers you the option of activating the "Same dimming time" function for the central switching and value dimming functions. In this way, all dimming outputs in a channel group which are controlled via the central function reach the required dimming value simultaneously. The settings for the dimming speeds are ignored with this function option (for further information, please refer to the section on dimming speed). You can use a parameter to determine whether an output should also be assigned to the "Same dimming time" function in relation to the central function:

Tab	Parameter
X: Central function	Same dimming time

Higher-level functions

With the logic operation, priority control and disable functions, the software application offers you three prioritised functions (with higher priority). The functions with higher priority are processed before functions with lower priority.

high priority	
3	Disable function
2	Logic operation or priority control
1	Switching, dimming, value dimming, time functions, scene, central function

low priority

Alternatively, you can activate the logic operation or priority control functions for an output channel using a parameter:


Tab	Parameter
X: General	Higher priority functions

You can also use a parameter to activate a disable function with the highest priority for each output channel:

Tab	Parameter
X: General	Disable function

Logic operation

A new object with the label "Logic object" (1 bit) is available for each output channel for which you have selected the logic operation as the prioritised function. The value of the "Logic object" is then logically linked both to the value of the "Switch object" and of the "Staircase lighting" object of this output channel.

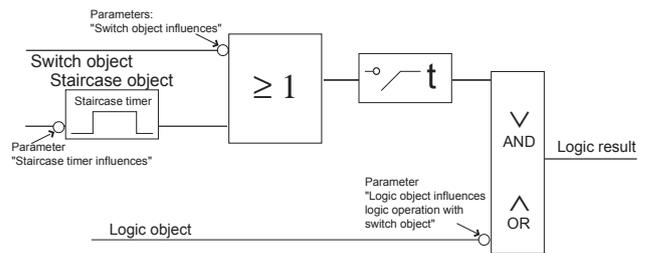

AND and OR functions are possible as logic operations:

Tab	Parameter
X: Logic operation	Logic operation

You can use the logic object to "override" the current brightness of a switch or staircase lighting function and to set it to a parameterisable brightness value.

Tab	Parameter
X: Logic operation	Brightness with logic object "0" in % (with AND logic operation)
X: Logic operation	Brightness with logic object "1" in % (with OR logic operation)

With an OR logic operation, the brightness for which the parameters can be set is specified with an object value "1", and with an AND logic operation, with an object value "0".

You can invert, or not invert, the effect of the current object values on this logic operation using parameters:

You can determine the input behaviour for the logic object:

Tab	Parameter
X: Logic function	Logic object influences

If you set the parameter value to "not inverted", the logic operation is formed with the current object value; the object value "0" remains "0" and the object value "1" remains "1".

If you set the parameter value to "inverted", the logic operation is formed with a value which is opposite to the current object value; Object value "0" becomes "1" and object value "1" becomes "0".

i The switch object and staircase lighting object are also combined via an OR logic operation when the logic function is inactive - see the "Staircase lighting function" section.




Please note the following important special feature:

You can also use telegrams for the "Dimming object" and "Central dimming object" (4 bit) or "Value object" and "Central value object" (1 byte) and scene telegrams to modify the brightness value of the dimming output while a logic function is active. However, the central object cannot be inverted.

Here, the output can also be switched on or off, even when you have selected a different behaviour when the logic function is active! Otherwise, an active logic function can only be overridden by the disable function with a higher priority.

Each time a telegram is received via the switch object, the central object or the staircase lighting object (before the warning), the logic function is updated and the logic operation result is re-calculated.

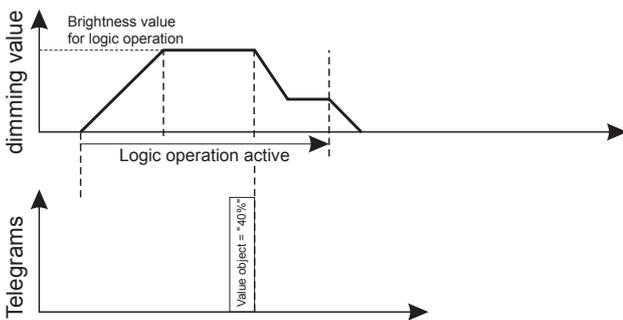

The brightness of the logic operation result and the dimming speed is defined by the last telegram.

If you have activated the logic function, the set value is activated after downloading or after the bus voltage has returned at the input to the logic functions, and is immediately effective.

Tab	Parameter
X: Logic function	Value of the logic object after bus voltage failure and downloading

Here, please also refer to the section "Startup and failure behaviour".

Priority control

If you have selected priority control for a channel, a new communication object labelled "Priority control" is provided for this channel, together with a new parameter window for further function settings. The "Priority control" object has a length of 2 bits, with the following data format:

Bit1	Bit0	Behaviour of the output
1	1	Priority control, dimming output "on"
0	1	End of priority control
1	0	Priority control, dimming output "off"
0	0	End of priority control

Activating priority control:

The priority control for the output is activated when the value "1" is received at bit1. Depending on bit0 of the received telegram, the assigned dimming output is then set according to your parameter settings:

- For bit0 = "1":

Tab	Parameter
X: Priority control	Behaviour at start of priority control "on"

If you wish to set a specific brightness, you can set this brightness via an additional parameter:

Tab	Parameter
X: Priority control	Required brightness at start of priority control "on" in %

- For bit0 = "0":

Tab	Parameter
X: Priority control	Behaviour at start of priority control "off"

If you wish to set a specific brightness, you can set this brightness via an additional parameter:

Tab	Parameter
X: Priority control	Required brightness at start of priority control "off" in %

Settings on start of a priority control:

- no response: The dimming output remains at its current brightness value at the start of the priority control. This output value can only be changed while the priority control is active by the disable function which has a higher priority.
- switch off: The dimming output is switched off.
- switch on at variable brightness: The dimming output is set to the defined brightness value.

Deactivating priority control

The priority controlled dimming output remains in the selected status until the priority control is released again by a new telegram with the value "0" to bit1. You can use parameters to set how a dimming output should respond when the priority control has been removed again:

Tab	Parameter
X: Priority control	Behaviour at the end of priority control


Setting options at the end of priority control:

- no response: The dimming output remains at its current output value until the output receives the next switch or dimming telegram.
- switch off: The dimming output is switched off at the end of priority control.
- switch on to variable brightness: The dimming output sets the brightness value which you have determined via an additional parameter:
- follows subordinate functions: Telegrams for the subordinate functions continue to be processed in the background while a priority control is active, but are not forwarded to the dimming outputs. After the priority control, the output is set to the value which has been calculated in the background.

Tab	Parameter
X: Priority control	Required brightness at end of priority control in %

Dimming speed of priority control

The dimming speed for changes in brightness during activation, deactivation and priority control is influenced by the dimming time reduction for higher priority functions in the current dimming time reduction set (please also refer to the section on dimming speeds). If a subordinate dimming procedure is currently active when the priority control is released, and you have set the "Behaviour at the end of priority control" to the "follows subordinate functions" value, the lights are dimmed down to the current dimming value with the dimming time reduction for higher priority functions in the current dimming time reduction set. The lights then continue to be dimmed with the dimming speed of the function which is currently active.

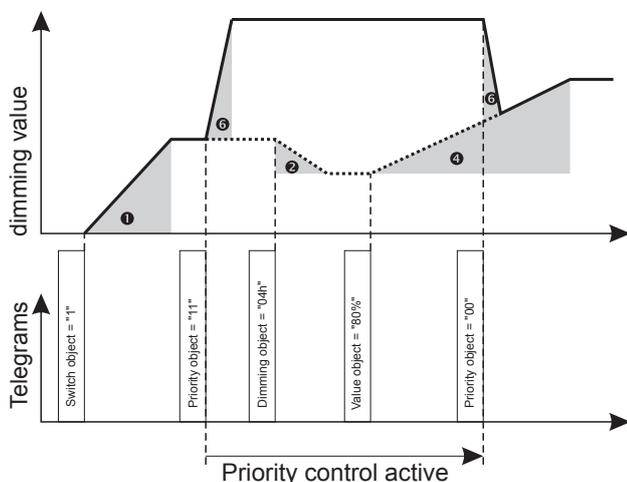

Parameter settings for the example in the image:

- Behaviour at start of priority control "on" = "switch on to variable brightness"

- Required brightness at start of priority control "off" in % = 100
- Behaviour at the end of priority control = "follows subordinate functions"

Image legend:

- 1: Dimming time reduction for switching telegrams and switching on staircase lighting.
- 2: Dimming time reduction for dimming telegrams.
- 4: Dimming time reduction for value telegrams.
- 5: Dimming time reduction for scene telegrams.
- 6: Dimming time reduction for prioritised functions.

Value of priority control after bus voltage failure

The bus voltage may fail while the priority control is active. You can specify the behaviour of the priority control when the bus voltage recovers by setting a parameter:

Tab	Parameter
X: Priority control	Behaviour of priority control after bus voltage recovery

The settings have the following meaning:

- inactive: After a bus voltage failure, the priority control is not active. It must be activated by a new telegram if necessary.
- active "off": After a bus voltage failure, the priority control is directly active "off". Subordinate functions are not set, but are processed only in the background. In order to deactivate, the actuator must receive an appropriate telegram.
- active "on": After a bus voltage failure, the priority control is directly active "on". Subordinate functions are not set, but are processed only in the background. In order to deactivate, the actuator must receive an appropriate telegram.
- as before bus voltage failure: The priority control is set to the status which was active before the bus voltage failure. If the function was active, it is now switched back to active again; if it was deactivated, it now remains switched off.

Disable function

If you have activated the disable function for a switching channel, a new communication object appears for this channel as a 1-bit object with the label "Disable object" and a new parameter window in which you can make the further function settings.

Activating the disable function

Please first specify the starting behaviour of the disable function.

Tab	Parameter
X: Disable function	Lock

You can use the "Lock" parameter to set the object value at which the function should be activated. If the

"Disable object" receives a telegram with the object value "0" or "1" for activation, the disable function is started. It remains active until the "Disable object" receives a telegram with the opposite object value. You can use additional setting options to specify the behaviour of the dimming output at the start and the end of a disable function:

Tab	Parameter
X: Disable function	Behaviour at start of lockout

Setting options:

- no response: The dimming output remains at its current value at the start of a disable function. This value can now no longer be changed as long as the disable function is active.
- switch off: The dimming output is switched off and remains in this state until the end of the disable function, or until the disable function receives the first active switching or dimming telegram.
- switch on at variable brightness: The dimming output sets the brightness value which you have determined via a parameter:

Tab	Parameter
X: Disable function	Required brightness at start of lockout in %

Deactivating the disable function

The disabled dimming output remains in the selected status until the disable function is released again by a new telegram with the value "0" or "1". You can use parameters to set how a dimming output should respond when the disable function has been removed again:

Tab	Parameter
X: Disable function	Behaviour at end of lockout

Settings:

- no response: The disable function is deactivated without the dimming output responding. The output remains at its current brightness value until the next active switching or dimming telegram.
- switch off: The dimming output is switched off at the end of the disable function.
- switch on to variable brightness: In order to set a variable brightness at the end of a disable function, an additional parameter appears:

Tab	Parameter
X: Disable function	Required brightness at end of lockout in %


- follows subordinate functions: Telegrams for the subordinate functions continue to be processed in the background while a disable function is active, but are not forwarded to the dimming outputs. After the end of the disable function, the dimming output is set to

the value which has been calculated in the background for the subordinate functions.

Dimming speed of the disable function

The dimming speed for changes in brightness during activation, deactivation and during a disable function is influenced by the setting for the current dimming time reduction set (please also refer to the section on dimming speeds). If a subordinate dimming procedure is currently active at the end of a disable function, and you have set the "Behaviour at end of lockout" to the "follows subordinate functions" value, the lights are dimmed down to the current dimming value with the dimming time reduction for higher priority functions in the dimming time reduction set. The lights then continue to be dimmed with the dimming speed of the function which is currently active.

The dimming speed for changes in brightness during activation, deactivation and during a disable function is influenced by the dimming time reduction for higher priority functions in the current dimming time reduction set (please also refer to the section on dimming speeds). If a subordinate dimming procedure is currently active when the priority control is released, and you have set the "Behaviour at the end of priority control" to the "follows subordinate functions" value, the lights are dimmed down to the current dimming value with the dimming time reduction for higher priority functions in the current dimming time reduction set. The lights then continue to be dimmed with the corresponding dimming speed of the function which is currently active.

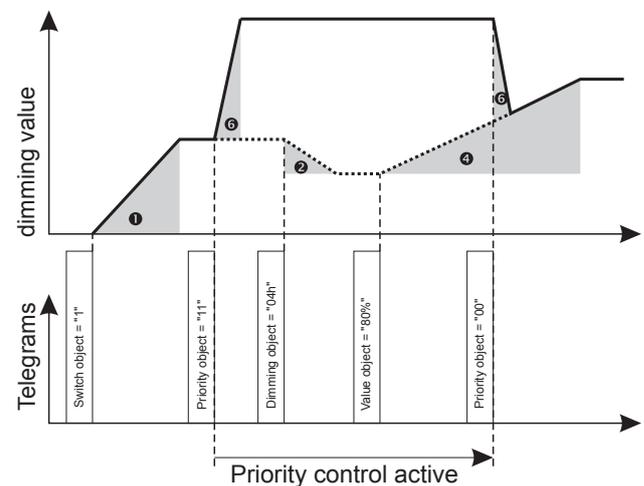

Parameter settings for the IMAGE:

- Lock = with object value "1"
- Behaviour at start of lockout = "switch on at variable brightness"
- Required brightness at start of lockout in % = 100
- Behaviour at end of lockout = "follows subordinate functions"

Image legend:

- ①: Dimming time reduction for switching telegrams and switching on staircase lighting.
- ②: Dimming time reduction for dimming telegrams.
- ④: Dimming time reduction for value telegrams.

- 5: Dimming time reduction for scene telegrams.
- 6: Dimming time reduction for prioritised functions.

Value of disable function after bus voltage failure

The bus voltage may fail while the disable function is active. You can specify the status of the disable function when the bus voltage recovers by setting a parameter:

Tab	Parameter
X: Disable function	Lockout status after bus voltage recovery

The settings have the following meaning:

- inactive: After a bus voltage failure, the disable function is not active. It must be activated by a new telegram if necessary.
- active: After a bus voltage failure, the disable function is directly active. Subordinate functions are not set, but are processed only in the background. In order to deactivate, the "Disable object" must receive an appropriate telegram.
- as before bus voltage failure: The disable function is set to the status which was active before the bus voltage failure. If the function was active, it is now switched back to active again; if it was deactivated, it now remains switched off.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Channel X Higher priority function	Logic object	2 bit	Low	WC	Transmit/ receive
Channel X Higher priority function	Priority control	2 bit	Low	WC	Transmit/ receive
Channel X Disable function	Disable object	1 bit	Low	WC	Transmit/ receive

● Status messages

The software application provides you with numerous options to report the current device status and the status of the dimming channels via communication objects. Depending on these status messages, you can trigger certain control processes or release and disable functions in the system. In addition, status messages are also suitable for displaying current operating states by means of visualisation software.

The status messages of the output channels are made available through communication objects. You can set the transmission characteristics of these status objects to one of the following values using parameters:

- deactivated:
The status object is not active.
- active status response object
When the status changes, the new status is automatically transmitted.
- passive status object:
The status object does not transmit its values. However, the current status is available in each case, and can be read out by other bus devices.

Status error (device-specific)

A communication object is provided in order to report error states caused by hardware, which you can priority activate for the appliance via a parameter:

Tab	Parameter
General	Status error

After activation, the additional communication object appears with the label "Feedback error" or "Status error", depending on the parameters set.

If a short circuit/overload, idle or excess temperature error occurs, this error status is reported. The error message is issued regardless of the output channel in which this error occurs. The object contains the value "1". A fault analysis is possible on site using the LEDs on the device. If the error has been rectified and the appliance again operates correctly, the object will receive the value "0".

If you have selected the value "Active status feedback object" for "Status error", the current status of the object is transmitted when an error occurs after the bus voltage returns.

For further information on the display of the device function, please refer to the following manual section "Manual operation and status displays".

Status of switch object (channel-specific)

The option is provided for each output channel to query or report the current status of the channel using the status feedback object. You can activate the feedback object for each channel individually. When you activate the feedback object, you simultaneously determine its transmission characteristic:

Tab	Parameter
X: General	Status switch

After you have activated the status feedback for the switch object in a channel, a new communication object appears for this channel. Depending on the transmission characteristic which you have selected, the designation of this object alternates between the "Feedback switch" or "Status switch" values.

The value of the feedback object of a channel always corresponds to the current output status ON or OFF. When dimmed, the setting corresponds to ON. The status of the feedback object corresponds to the status display "On" of the channel (for further

information, please refer to the section on "Manual operation and status displays"). If you have set the feedback object as the status feedback object, the current object value is transmitted to the bus with each status change from OFF to ON, or vice-versa.

i The value of the switch object may differ from the current channel value (e.g. with parameterised delay times). For this reason, use the status of the channel as the status feedback object.

Status of value object/brightness value (channel-specific)

The option is also provided for each output channel to query or report the current brightness value of the channel using the communication object. You can activate the feedback object for each channel individually. When you activate the feedback object, you simultaneously determine its transmission characteristic:

Tab	Parameter
X: General	Status of value object/ brightness value

After you have activated the status feedback for the brightness value of a channel, a new communication object appears for this channel. Depending on the transmission characteristic which you have selected, the designation of this object alternates between the "Feedback value object/brightness value" or "Status value object/brightness value" values.

The value of the feedback object of a channel always corresponds to the current dimming value of the output between 0% and 100% in 255 steps.

If you have set the feedback object as the status feedback object, the current object value is transmitted to the bus, **when the output has reached a stable dimming value**. The object value is therefore transmitted when:

- a dimming procedure is completed
- the minimum or maximum dimming value has been reached
- a dimming procedure has been stopped by manual operation

The object value of the feedback object as a passive status object always corresponds to the current output value.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Status error	Status error	1 bit/	Low	LC	Transmit/ receive
Channel X Status AB	Feedback AB	1 bit/1 byte/	Low	WCT	Transmit/ receive

● **Manual operation**

Manual operation

A channel key for each output channel is located at the front of a dimming actuator. You can use this channel key to manually operate the assigned output (channel key operation). In the same way, each output channel has a connection option for external operating elements (electric extension units or mechanical push-buttons) for operation from another location (extension unit operation). For further information, please refer to the operating instructions for the appliance.

Releasing / disabling channel operation and extension unit operation

You can specify as a priority the operation options for the appliance using channel keys or external extension units by setting the following parameters:

Tab	Parameter
General	Channel key operation
	Extension input

You can continuously enable and disable the manual operation options using the parameter values "enabled" and "disabled".

If you have selected the parameter setting "can be switched on and off via object", new communication objects appear which enable you to release the function via bus telegrams, depending on the control. The new communication objects are labelled either "disable channel key operation" or "disable extension unit operation", depending on the function. With this deactivation option, the respective function is disabled when the telegram value "1" is received, and enabled when the telegram value "0" is received.

i In this case, operation is always switched on following initialisation and the application download.

When the extension unit operation is released with reference to the object, you can still activate and deactivate this function separately for each channel:

Tab	Parameter
X: General	Extension input

If you have deactivated the release of the extension unit operation via the object value for a channel, the extension unit operation will not be active for this channel.

Channel operation and extension unit operation

If you have switched on the channel key operation and/or the extension unit operation or have released them via an object, dimming commands (longer push-button action) or switch commands (short push-button action) are generated when operating the corresponding operating elements. Here, both operating options function with the same priority.

The channel operation always affects the "Switch object" and the "Dimming object" of the corresponding channel.

During extension unit operation, you can set the object which you wish to be influenced by the function:

Tab	Parameter
X: General	Extension input influences

Settings:

- "Switch object": Operation via extension units affects the "Switch object" and the "Dimming object" of the corresponding channel.
- "Staircase timer": Operation of the extension units influences the staircase timer object. In this way, you can switch on or retrigger the staircase lighting function. The trigger function depends on your parameter settings for the staircase lighting function (see the manual section on "Staircase lighting function").

Commands from channel key operation and extension unit operation which influence the "Switch object" and "Dimming object" of a channel have the same value as the commands via these objects. The last active command is forwarded to the dimming output. Each push-button action during channel key operation or extension unit operation influences the last output value in the same way as a toggle key. This means that the output is switched off after a short push-button action, when it has previously been switched on, and is switched on when it has previously been switched off. A long push-button action on the channel key or extension unit acts in the same way as a relative dimming command. The output is dimmed up or down for the period of the push-button action, depending on which dimming direction was previously active for a relative dimming command. Relative dimming commands are either issued following a long push-button action during channel key operation, or during the extension unit operation itself, or via the "Dimming object" or "Central dimming object".

The priority of channel key operation and extension unit operation

Channel key operation and extension unit operation function with the same priority level as the switching function and dimming function (please refer to the section on priority) which they influence. This means that a manual operation via these functions is not forwarded to the dimming outputs as long as a higher priority function is active. The corresponding operations are processed in the background by the software, however.

Channel key operation and extension unit operation during emergency operation

When only the operating voltage, but not the bus voltage is applied to the appliance, the device is in the "emergency operation" mode. In emergency operation mode, the channel key operation and extension unit operation are always switched on and function in parallel. In this way, the output channels can also be switched on and off (short push-button action) or dimmed (long push-button action) without bus telegrams.

i In emergency operation mode, the dimming direction changes when the maximum or minimum dimming value is reached. In other words, as long as the key is kept pressed down, the output dims continuously up and down!

i In emergency operation mode, all parameter settings are deactivated! The missing values for the minimum/maximum dimming value and for the dimming curves must be taken into account in particular.

Communication objects

You can select the following communication objects:

Per input:

Function	Object name	Type	Prio	Flags	Behaviour
Channel key operation	Disable channel operation	1 bit	Low	SLK	Transmit/receive
Extension unit operation	Disable extension inputs	1 bit	Low	WRC	Transmit/receive

● **Status displays**

The dimming actuator has different LED displays, which show the current status of the appliance hardware (red error LED for each output), the current status of the switch outputs (yellow status LED for each output), and the operation status (green run LED).

Status of the appliance hardware:

A red LED display (error LED) is assigned to each output channel in order to indicate error output states or an excess temperature in the appliance. In normal operating mode, the error LEDs are switched off. Please note that some error states must be acknowledged in order to deactivate them.

The following errors may occur:

- Overload and short circuit
 If an overload or a short circuit occurs on an output channel, the channel concerned is switched off. The error LED on the output lights up. The status LED on the output does not light up. After the error state has been rectified, you can acknowledge this error message in two different

ways:

- Acknowledgement via push-button action on the channel key: After acknowledgement, the output channel carries out a load detection. If this is successful, the output is dimmed to the max. brightness.
- Acknowledgement by switching the operating voltage off and on: In this case, the load detection is only carried out when the first switching or dimming signal is issued on the output (by pressing the channel key, extension unit or EIB). When the load detection is initialised by the channel key or the extension input, the max. dimming value is then set.
- Idle state
 If the appliance hardware detects an idle state at an output channel, the channel is switched off. The error LED on the output lights up. The status LED on the output lights up. This state does not need to be acknowledged. After a load is connected, the actuator carries out a load detection when the first switching or dimming signal is received (by pressing the channel key, the extension unit or the EIB). When the load detection is initialised by the channel key or the extension input, the max. dimming value is then set.
- Excess temperature
 The temperature in the housing of the dimming actuator is constantly monitored. If the measured temperature exceeds a critical value, all the dimming outputs which are switched on are dimmed down to the min. dimming brightness. In this case, the run LED flashes, all error LEDs light up, and your only option is to switch off the dimming channels. If the temperature value remains above the critical value within the next 15 minutes, or if it continues to rise, all outputs are switched off. You can only switch the outputs back on when the temperature value has cooled to its normal range. If the temperature value falls back to its normal range within 15 minutes following an excess temperature, all dimming outputs are set back to their former dimming value.

i If one of the above error states occurs, this can also be reported as a status via a bus telegram. Please refer to the manual section on "Status reports".

i If a short circuit or idle state occurs on an output channel during operation, no further bus telegrams are evaluated for this channel, and after the error has been reported via the status object, no further bus telegrams are transmitted. If a successful load detection has been completed for this channel after such an error has occurred (the output is switched to the max. brightness), bus operation is again possible.

i If another error is identified during a load detection, or if another error occurs, the load

detection is interrupted. A maximum of 3 load detections can be triggered via bus telegrams. After the third unsuccessful load detection, the load detection can only be triggered via the channel keys or the extension input!

Status of the switch outputs

The yellow status display on a channel indicates the switching or dimming status of an output channel. If the channel is switched off, the status display is also switched off. The status display lights up when the channel is switched on or dimmed.

Operational status

The green run LED lights up when the dimming actuator is functioning correctly, the software application is running and the operating voltage and bus voltage are being applied.

Overview of status displays

Operating display	Channel status display	Channel error display	
on	off	off	Universal dimming actuator ready for operation (mains voltage and bus voltage available) and channel switched off
on	on	off	Universal dimming actuator ready for operation (mains voltage and bus voltage available), channel switched on (switch object = "1") or load detection
on	off	on	Overload or short circuit. The channel has been switched off. Mains and bus voltage available
on	on	on	No load at output (idle). The channel has been switched off. Mains and bus voltage available
off	off	off	No bus voltage and channel switched off, or no mains voltage
off	on	off	No bus voltage and channel switched on
off	off	on	Overload or short circuit and no bus voltage. The channel has been switched off.
off	on	on	No load at output (idle) and no bus voltage. The channel has been switched off.
flashes	on/off	all on	Excess temperature. All channels that are switched on are dimmed to minimum power/minimum brightness. Channels which are currently switched off cannot be switched on. See also the section "How to recognise potential faults".

● **Startup and failure behaviour**

Load detection

In order to be able to set the dimming behaviour (phase control or phase alignment) automatically to the connected lamp load, each channel must conduct a "load detection" prior to operation. The load detection can be conducted as soon as the loads are connected and the operating voltage has been switched on. You can trigger the load detection by activating a channel key, or alternatively, an extension unit push-button. If the appliance has already been programmed, you can also activate the load detection via the initial ON or dimming telegram.

A load detection is required when a short circuit or idle state has occurred at an output (see also the section on "Status displays").

During the load detection, the output is switched on at max. brightness for approx. 10s; then it is switched off and dimmed back up to the max. brightness or to the parameterised value. The channel is then ready for operation.

i If another error is identified during a load detection, or if another error occurs, the load detection is interrupted. A maximum of 3 load detections can be triggered via bus telegrams. After the third unsuccessful load detection, the load detection can only be triggered via the channel keys or the extension input!

Physical address

When the operating and bus voltage have been applied to the dimming actuator, you can issue the physical address using the ETS software. Press the programming key to put the appliance into programming mode. This is indicated when the red programming LED lights up. Now you can load the physical address. When the load has been successfully completed, the red programming LED goes out.

Behaviour after download

The behaviour after the application has been downloaded corresponds to the behaviour following the recovery of the bus voltage when the operating voltage is present, as described below. You can parameterise whether the priority control and the disable function are active after a download. For the scene function, you can also specify whether the stored brightness values should be overwritten by your settings during a download, or not (please refer to the section "Scene function").

Behaviour on failure of the operating voltage

No functions are possible when the operating voltage fails. All channels and display elements are switched off. Please note that the appliance must in all cases conduct a load detection when the operating voltage returns.

Behaviour when the operating voltage returns and the bus voltage is absent (emergency operation)

All channels remains switched off. As soon as you wish to switch on a channel by activating the channel key or an extension unit push-button, the appliance conducts a load detection. After the load detection, you can operate the output channels using the channel keys and extension units.

Behaviour when the operating voltage returns and the bus voltage is present

The channels remains switched off. As soon as you wish to switch on a channel by activating the channel key or an extension unit push-button, or via a bus telegram, the appliance conducts a load detection. After the load detection, you can continue to operate the output channels as before.

Behaviour when the bus voltage fails and the operating voltage is present

When the bus voltage fails, the brightness values on the output channels do not change. The appliance is now running in emergency operation mode. You can operate the output via the channel keys or in extension unit operation mode. The operating display (run LED) is switched off.

The current values of the priority control or logic object and the disable object are stored.

Behaviour when the bus voltage returns and the operating voltage is present

You can set the behaviour of the appliance functions individually for each channel of the dimming actuator following a bus voltage failure.

After a bus voltage failure, the speed set "0" is active. The dimming speed is oriented to the active function.

- Value of switch object after bus voltage failure

You can specify the behaviour of the switch object after a bus voltage failure or a download using a parameter:

Tab	Parameter
X: General	Behaviour during bus voltage recovery and download

Settings:

- no response: The output channel remains at its current brightness value.

-switch off: The output is switched off.

-switch on with starting behaviour, see the "Starting behaviour" parameters in the tab Channel:X.

The output is switched on at the set initial brightness.

If other advanced or priority functions are active when a bus voltage failure occurs, your settings for the reaction of the switch object may be overwritten.

- Value of logic object after bus voltage failure

Tab	Parameter
X: Logic operation	Value of the logic object after bus voltage failure and download

If you have activated the logic function, the set value for each output channel is activated after downloading or after the bus voltage has returned at the input of the logic functions.

- Value of priority control after bus voltage failure

Sie können das Verhalten der Zwangsführung bei Wiederkehr der Busspannung durch einen Parameter festlegen:

Tab	Parameter
X: Priority control	Behaviour of priority control after bus voltage recovery

The settings have the following meaning:

- inactive: After a bus voltage failure, the priority control is not active. It must be activated by a new telegram if necessary.

- active "off": After a bus voltage failure, the priority control is directly active with the behaviour at the start of priority control "off". Subordinate functions are not set, but are processed only in the background. In order to deactivate, the actuator must receive an appropriate telegram.

- active "on": After a bus voltage failure, the priority control is directly active with the behaviour at the start of priority control "on". Subordinate functions are not set, but are processed only in the background. In order to deactivate, the actuator must receive an appropriate telegram.

- as before bus voltage failure: The priority control is set to the status which was active before the bus voltage failure. If the function was active, it is now switched back to active again; if it was deactivated, it now remains switched off.

- Value of disable function after bus voltage failure

You can specify the status of the disable function when the bus voltage recovers by setting a parameter:

Tab	Parameter
X: Disable function	Lock status after bus voltage recovery

The settings have the following meaning:

- inactive: After a bus voltage failure, the disable function is not active. It must be activated by a new telegram if necessary.
- active: After a bus voltage failure, the disable function is directly active. Subordinate functions are not set, but are processed only in the background. In order to deactivate, the "disable object" must receive an appropriate telegram.
- as before bus voltage failure: The disable function is set to the status which was active before the bus voltage failure. If the function was active, it is now switched back to active again; if it was deactivated, it now remains switched off.

Parameters and settings

This section contains all the parameters of the ETS application with their settings. Preset values are printed in bold.

General	
Parameter	Setting
Channel X	deactivated
	activated
Scenes	disabled
	enabled
Extension unit scenes	disabled
	enabled
Central function	disabled
	enabled
Central switch object	deactivated
	activated
Central dimming object	deactivated
	activated
Central value object	deactivated
	activated
Same dimming time with central function and scenes	disabled
	enabled
Channel operation	enabled
	disabled
	can be switched on and off via the object
Extension inputs	enabled
	disabled
	can be switched on and off via the object
Status error	deactivated
	active status feedback object
	passive status object

Same dimming time	
Parameter	Setting
Time base for same dimming time	1s , 1min, 1hour
Time factor for same dimming time 1-255	1.. 5 ..255
Time factor for same dimming time modifiable via the bus	deactivated activated

X: General	
Parameter	Setting
Minimum dimming value in %	1.. 7 ..100
Maximum dimming value in %	1.. 100
Starting behaviour	Max. brightness
	variable brightness
	last brightness value (memory)
Basic dimming curve	Incandescent lamps
	Halogen lamps
	modifiable
Dimming object switches channel	not at all
	only on, not off
	only off, not on
	on and off

Value object switches channel	not at all
	only on, not off
	only off, not on
	on and off
Extension input influences	Switch object
	Staircase timer
Extension inputs	enabled
	selectable via object
Delay times	disabled
	enabled
Staircase lighting function	deactivated
	activated
Switch object influences logic operation	unchanged
	inverted
Scenes	disabled
	enabled
Central function	disabled
	enabled
Higher priority functions	deactivated
	Logic operation
	Priority control
Disable function	deactivated
	activated
Behaviour during bus voltage return and downloading	no response
	switch off
	switch on at variable brightness
Required brightness in % when bus voltage recovers	0..100
Status switch	deactivated
	activated
Status of value object/brightness value	deactivated
	activated

X: Basic dimming curve	
Parameter	Setting
1. threshold value in %	0.. 25 ..100
2. threshold value in %	0.. 50 ..100
3. threshold value in %	0.. 75 ..100
Time base for 1st dimming section	100ms , 1s, 1min, 1hour
Time factor for 4th dimming section (1-255)	1.. 230 ..255
Time base for 2nd dimming section	100ms , 1s, 1min, 1hour
Time factor for 4th dimming section (2-255)	1.. 180 ..255
Time base for 3rd dimming section	100ms , 1s, 1min, 1hour
Time factor for 4th dimming section (3-255)	1.. 120 ..255
Time base for 4th dimming section	100ms , 1s, 1min, 1hour
Time factor for 4th dimming section (4-255)	1.. 70 ..255

X: Dimming time reductions	
Parameter	Setting
Dimming time reduction object for dimming curve	deactivated activated
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for switching telegrams and switching on staircase lighting	1.. 2 ..100
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for dimming telegrams	1.. 10 ..100
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for switching off staircase lighting	1.. 50 ..100
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for value telegrams	1.. 20 ..100
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for scene telegrams	1.. 32 ..100
Set 0 to 3: Dimming time reduction (1-100) or (1-255) for higher priority functions	1.. 2 ..100
Set 1 to 3	disabled enabled

Delay times	
Parameter	Setting
ON delay	deactivated retriggerable not retriggerable
Output during the ON delay	switched off at minimum brightness / lower dimming limit
Time base for ON delay	100 ms 1 s 1 min 1hour
Time factor for ON delay (1-255)	1.. 3 ..255
OFF delay	deactivated retriggerable not retriggerable
Time base for OFF delay	100 ms 1 s 1 min 1hour
Time factor for OFF delay (1-255)	1.. 3 ..255

X: Staircase timer	
Parameter	Setting
Staircase lighting function	with manual OFF, cannot be retriggered with manual OFF, can be retriggered with manual OFF, accumulate time without manual OFF, cannot be retriggered without manual OFF, can be retriggered

	without manual OFF, accumulate time
Max. number of time accumulations (2-255)	2.. 3 ..255
Time base for staircase timer	1 s 1 min 1hour
Time factor for staircase timer (1-255)	1.. 3 ..255
Staircase timer influences logic operation	unchanged inverted
Cut-out warning for staircase lighting time	deactivated activated
Warning time for staircase lighting time in seconds (1-255)	1.. 30 ..255

X: Scenes	
Parameter	Setting
Replace scene values in the actuator on download	deactivated activated
Same dimming time	deactivated activated
Scene 1 to scene 8	deactivated activated (scene 1 activated)
Scene 1 to scene 8 scene number (0-63)	0 ..63
Scene 1 to scene 8 brightness value in %	0.. 15 ..100%

X: Central function	
Parameter	Setting
Same dimming time	deactivated activated
Function with the central switch object = 0	no response switch off switch on at variable brightness
Function with the central switch object = 1	no response switch off switch on at variable brightness
Required brightness with central switch object = 0 in %	5.. 100
Required brightness with central switch object = 1 in %	5.. 100

X: Logic operation	
Parameter	Setting
Logic operation	AND OR
Logic object influences	unchanged inverted
Value of the logic object after bus voltage failure and downloading	0 1
Brightness with logic object "0" in % (with AND logic operation)	5.. 100
Brightness with logic object "1" in % (with OR logic operation)	5.. 100

X: Priority control	
Parameter	Setting
Behaviour on start of priority control "on"	no response
	switch off
	switch on at variable brightness
Required brightness on start of priority control "on" in %	5.. 100
Behaviour on start of priority control "off"	no response
	switch off
	switch on at variable brightness
Required brightness on start of priority control "off" in %	5..100
Behaviour at the end of priority control	no response
	switch off
	switch on at variable brightness
	follows subordinate functions
Required brightness at end of priority control in %	5.. 100
Behaviour of priority control after bus voltage recovery	inactive
	active "off"
	active "on"
	as before bus voltage failure

X: Disable function	
Parameter	Setting
Lock	for object value "0"
	for object value "1"
Behaviour at start of lockout	no response
	switch off
	switch on at variable brightness
Required brightness at start of lockout in %	5.. 100
Behaviour at end of lockout	no response
	switch off
	switch on at variable brightness
	follows subordinate functions
Required brightness at end of lockout in %	5.. 100
Lock status after bus voltage recovery	inactive
	active
	as before bus voltage failure